

UNOFFICIAL TRANSLATION

# Development Framework for Offshore Wind Energy

*Adopted by the Council of Ministers in May 2025*

## *Disclaimer*

This English translation has been produced for information purposes only and is not intended to replace any legal or formally communicated rules, regulations or requirements. Rights do not apply. The Dutch version can be found [here](#).

## Publication details

### Development Framework for Offshore Wind Energy

Ministry of Economic Affairs and Climate Policy  
Directorate-General for Climate and Energy  
PO Box 20401  
2500 EK The Hague

Final

First version adopted by the Council of Ministers on 1 July 2016

Updated 15 June 2017 by the Minister:

- Final delivery date set for completion of the part of the offshore grid for connection to the wind farms at Hollandse Kust (zuid) Wind Farm Sites I and II. See Section 4.2;
- The Government's designation on 8 December 2016 of the area between the 10 and 12 nautical mile zones in the Hollandse Kust (zuid and noord) Wind Farm Zones has been incorporated in Figures 1 and 4 as well as in Section 2.2.

Updated September 2018 by the Minister:

- Final delivery date set for completion of the part of the offshore grid for connection to the wind farms at Hollandse Kust (zuid) Wind Farm Sites III and IV. See Section 4.2;
- Sections 1.4, 3.3, and 4.1 updated for tenders already completed and the published Offshore Wind Energy Roadmap 2030.
- As they appeared to cause confusion, the terms “nominal capacity” and “installed capacity” in the text (particularly in Sections 3.5 and 3.6) have been replaced by “installed capacity” in accordance with the provisions and definitions of Wind Farm Site Decisions for Hollandse Kust (zuid) Wind Farm Sites III and IV.
- Text adapted to allow for the possibility of tenders without subsidy.
- Lost links to documents on the internet fixed.

Updated Autumn 2019, adopted by the Council of Ministers on 8 November 2019:

- Final delivery date set for completion of the part of the offshore grid for connection to the wind farm at Hollandse Kust (noord) Wind Farm Site V. See Section 4.2;
- Amendments to the Offshore Wind Energy Roadmap 2030:
  - Reference to specification of 49 TWh offshore wind energy in 2030 in the Coalition and Climate Agreements;
  - Addition of the Hollandse Kust (west), Ten noorden van de Waddeneilanden and IJmuiden Ver Wind Farm Zones;
  - Addition of direct current concept for IJmuiden Ver;
  - Addition of guaranteed transmission capacity of 2 GW for direct current concept for IJmuiden Ver;
- Removal of provisions for stepping-stone function and addition of "WindConnector" (Section 3.3);
- Changes in provisions to bring them in line with Metering Code (Section 3.10);
- Addition of provisions on nature-inclusive construction (Section 3.11);
- Clarification on delivery (date) provisions (Chapter 4);
- Update and clarification of provisions on service life (Chapter 5).

Updated Spring 2020, adopted by the Council of Ministers on 20 May 2020:

- Expected commissioning dates of wind farms in Table 1 adjusted to match the most up-to-date timetable (Section 2.2);

- In respect of direct current platforms in IJmuiden Ver, provisions have been added regarding:
  - Access and accessibility (Section 3.4);
  - Availability and guaranteed transmission capacity (Section 3.5);
  - Maximum power input (Section 3.6);
  - Connections (Section 3.7);
  - Electrical properties and protection (Section 3.8);
- Inclusion of the Minister's decision regarding efforts to make the direct current platforms in IJmuiden Ver suitable for a 'WindConnector' (Section 3.9, previously Section 3.4)
- Inclusion of the Minister's decision regarding efforts to make the alternating current platform in Hollandse Kust (noord) suitable for electrification of oil and gas platforms (new Section 3.10);
- Addition of completion procedure and dates for direct current connections in IJmuiden Ver (text and Tables 4 and 6 in Section 4.2);
- Delivery date adjusted of the offshore grid for Hollandse Kust (zuid) Sites I and II, as a result of the agreement on changing that delivery date between the permit holder of those sites and TenneT (Table 3 in Section 4.2);
- Amendment of provisions on the service life of the offshore grid (Chapter 5).

Updated May 2021 by the Minister:

- Final delivery date set for completion of the part of the offshore grid for connection to the wind farms at Hollandse Kust (west) Wind Farm Sites VI and VII. See Section 4.2;
- Text on the parliamentary debate on the bill to amend the Offshore Wind Energy Act (Wet windenergie op zee) updated. See Section 5.3.

Updated June 2022, adopted by the Council of Ministers on 10 June 2022:

- Amendment of Section 1.1 to reflect the increased target for offshore wind energy by 2030 of the fourth Rutte Cabinet and clarification of government role.
- Inclusion of an updated map of the wind farm zones to which this Development Framework relates (Section 2.1);
- Addition to the Roadmap of (parts of) wind farm zones from the Additional Offshore Wind Energy Roadmap 2030 Letter to Parliament (Section 2.2);
- Expected commissioning dates of wind farms in Table 1 adjusted to match the most up-to-date timetable (Section 2.2);
- Amendment of connection sites for IJmuiden Ver Wind Farm Sites I to IV in Table 2, based on preferred alternative choice, and addition of offshore grid connection sites for the Additional Offshore Wind Energy Roadmap 2030 (Section 3.3);
- Inclusion of option to conclude conditional transmission agreements (Section 3.5);
- Text about WindConnector generalised to hybrid connections (Section 3.9);
- Addition of making the alternating current platform in Ten noorden van de Waddeneilanden suitable for electrification of oil and gas platforms (Section 3.10);
- Requirements for suppliers included (Section 3.13).
- Texts regarding provisions for IJmuiden Ver direct current connections have been generalised to ensure they also apply to the direct current connections added for the Additional Offshore Wind Energy Roadmap 2030 (Chapters 3 and 4);
- Inclusion of the provision that, where required, TenneT may award contracts before final permits have been obtained (Section 4.2);
- Addition of the offshore grid for the Additional Offshore Wind Energy Roadmap 2030 in Table 4 and Table 6. Indicative delivery dates in Table 6 amended to reflect the most up-to-date timetable (Section 4.2);
- Chapter 5 (Service life and depreciation of the offshore grid) updated based on the amended Offshore Wind Energy Act (longer permit period).

Updated October 2023, adopted by the Council of Ministers on 27 October 2023:

- It is established that the alternating current platform for Ten noorden van de Waddeneilanden will be equipped with a helicopter deck (Section 3.4.1);
- The provision regarding the number of J-tubes of a direct current platform has been revised in connection with the possibility of customer connections (Section 3.7.2);
- The provisions on the number of connection fields of a direct current platform have been revised in connection with the possibility of customer connections (Section 3.8.2);
- There will be a fibre optic connection between the nearby direct current platform for two-way data traffic (Section 3.8.2);
- TenneT is asked to make preparations for the development and connection of one or more offshore energy nodes and for the development of a hybrid connection from the Nederwiek Wind Farm Zone to the United Kingdom. See Section 3.9;
- A provision on customer connections to direct current platforms is included (Section 3.10);
- TenneT is constructing the offshore grid in accordance with the Clean and Emission-Free Construction Agreement (*Convenant Schoon en Emissieloos Bouwen*, SEB). See Section 3.12;
- Final delivery dates set for the part of the offshore grid connecting to IJmuiden Ver Wind Farm Sites Alpha and Beta. Also clarifies the explanation of the delivery dates, see Section 4.2.2;
- The text on delivery dates in relation to tenders and commissioning of wind farms has been clarified. Added to this is that the Minister can adjust the delivery dates for the commissioning of the wind farm(s) if there is a significant delay in the permit(s) becoming irrevocable. See Section 4.2.3;
- The names of wind farm sites in the IJmuiden Ver Wind Farm Zone have been modified throughout the document.

Update April 2024 by the Minister:

- Indicative delivery dates and milestones updated, see Table 1 and Table 6;
- The decision to include Doordewind Site I, Nederwiek Site III and Hollandse Kust (west) Site VIII in the Additional Offshore Wind Energy Roadmap and transfer the development of Doordewind Site II to the subsequent phase of offshore wind development after the current Roadmap (see Section 2.2, Table 1 and Table 4)
- Definition of Milestone 0 adjusted, see Section 4.2.2.

Update December 2024 by the Minister:

- Preparatory activities for DoordeWind Site II included, so that they can run simultaneously with DoordeWind Site I. See Section 2.2
- Inclusion of LionLink, with which TenneT can develop these, see Section 3.9
- Splitting of a number of sites from 1 x 2 GW to 2 x 1 GW and update of the delivery dates of Nederwiek I-A and I-B, see Tables 1, 2, 4 and 6.
- Change in the number of connection fields where two inter-array cables can be connected to a DC platform (see Section 3.8.2).
- Reservation of a number of customer connections (see Section 3.10)
- Additional information included on the sustainability regulations that TenneT must comply with. See Section 3.12.
- General update.

Update May 2025, adopted by the Council of Ministers on 23 May 2025:

- The development of one additional wind farm (2 GW) added, indicative location Doordewind Site II. See Section 2.3 (new) and Tables 1, 2, 4 and 6.
- Order to TenneT to prepare deep landings (see Section 3.3.2 (new))
- Explanation of the distribution of connection fields for a 2 GW site that is split into two x 1 GW (see Section 3.8.2)

- Change in the definition of customer connection, possibility of feeding in non-wind energy and wind energy from another wind farm added (see Sections 3.8.2 and 3.10).
- General update, including Figure 1.

# Contents

## **1 Why a Development Framework for Offshore Wind Energy?**

- 1.1 Rationale behind the Development Framework
- 1.2 Objective of the Development Framework
- 1.3 Assessment against the Development Framework
- 1.4 Scope and updating of the Development Framework
- 1.5 Content of the Development Framework
- 1.6 Realisation of this Development Framework

## **2 Sequence for development of the wind farms**

- 2.1 Clustered realisation in designated wind farm zones
- 2.2 Offshore Wind Energy Roadmap

## **3 Method of connecting the wind farms**

- 3.1 Background
- 3.2 Concept for the offshore grid
- 3.3 Connection locations, connection method and deep landings
- 3.4 Platform locations and accessibility
- 3.5 Availability and minimum guaranteed transmission capacity
- 3.6 Maximum power input from wind farms
- 3.7 Wind turbine and export cable connections
- 3.8 Electrical properties and protection
- 3.9 Hybrid connections
- 3.10 Electrification of oil and gas platforms
- 3.11 Measuring electricity yield
- 3.12 Shared services and nature-inclusive design, clean, emission-free construction and corporate social responsibility
- 3.13 Requirements for suppliers

## **4 Time frame**

- 4.1 Wind farm commissioning timeline
- 4.2. Delivery dates for the offshore grid

## **5 Service life and offshore grid depreciation**

- 5.1 ACM determines the depreciation period for the offshore grid
- 5.2 Required minimum lifespan of the offshore grid

# 1 Why a Development Framework Offshore Wind Energy?

## 1.1 Rationale behind the Development Framework

The Government has set the target of achieving a reduction in CO<sub>2</sub> emissions of at least 55% in 2030 compared to 1990.<sup>1</sup> This will involve, amongst other things, a total installed offshore wind capacity of about 21 gigawatts (GW, this equals 21,000 megawatts (MW)) offshore wind by 2032<sup>2</sup> under the current Roadmap and around 50 GW in 2040<sup>3</sup>. This requires a systematic approach, with a management role for the Government. Part of this approach is to oversee construction of an offshore grid. To do this, it is preferred to work with a plan that includes investments for the offshore grid, comparable with the plans the transmission system operators draw up for onshore grids. However, the complicating factor is that the transmission system operator for the offshore grid and market parties cannot, in principle, independently evaluate the basic principles upon which their investment plan should be founded. After all, where and when wind farms can be constructed in the coming years and their size depends on Government policy.

Management by the Government is exercised through:

- The North Sea Programme<sup>4</sup>, which is part of the National Water Programme. Government designates wind farm zones as part of the North Sea Programme;
- Wind Farm Site Decisions and wind farm permits issued under the Offshore Wind Energy Act. In addition, the Government coordinates the spatial planning procedures for construction of the offshore grid, with the project procedure under the Environmental Act, (previously under the National Coordination Scheme (*rijkscoördinatieregeling*, RCR);
- If necessary: subsidies under the Stimulation of Sustainable Energy Production and Climate Transition Decision (*Besluit stimulering duurzame energieproductie en klimaattransitie*);
- An Offshore Wind Energy Roadmap, in which the Government indicates when certain wind farm zones, or parts thereof, will be developed. The Government developed and updated the Roadmap in phases, successively based on the Energy Agreement (2013)<sup>5</sup> and the Climate Agreement (2019)<sup>6</sup>, informing the House of Representatives by means of several letters;<sup>7</sup>
- A Development Framework for Offshore Wind Energy, based on Section 16e of the Electricity Act 1998 (*Elektriciteitswet 1998*). This section stipulates that the following should, in any case, be included in the Development Framework:
  - a. The location of one or more wind farms;
  - b. The expected commissioning date of each wind farm;
  - c. The expected service life of wind farms;
  - d. The maximum capacity of each wind farm;
  - e. The minimum transmission capacity required for each wind farm;
  - f. The method of electrical connection for each wind farm;
  - g. Planned delivery dates for parts of the offshore grid;
  - h. Future offshore wind developments that are taken into account for the electrical connection.

Parts a to d above relate to the wind farms and summarise the letters from the Government regarding the Roadmap. Most of this can be found in Chapter 2 of the current Development Framework. Parts e to h relate to the offshore grid and are covered in Chapters 3 to 5.

Section 16e of the Electricity Act 1998 stipulates that the Minister defines this Development Framework.

---

<sup>1</sup> Parliamentary Paper 35788, No. 77, Annex blg-1009826.

<sup>2</sup> Parliamentary Paper 33561, No. 61

<sup>3</sup> Parliamentary Paper 33561, No. 54

<sup>4</sup> The currently applicable version is the North Sea Programme 2022-2027, see Parliamentary Paper 35325, No. 5, blg-1022234.

<sup>5</sup> Energy Agreement for Sustainable Growth, 6 September 2013 (Parliamentary Paper 30 196, No. 202, blg-248998).

<sup>6</sup> Climate Agreement, 28 June 2019, Parliamentary Paper 32813, No. H, blg-890294.

<sup>7</sup> The Offshore Wind Energy Roadmap consists of two parts: one part until the end of 2023 (based on the 2013 Energy Agreement; see Parliamentary Paper 33 561, No. A/11) and another part for the years 2024 to 2030 (based on the (draft) Climate Agreement; see Parliamentary Paper 33561, No. 42 and Parliamentary Paper 33561, No. 48).

## 1.2 Objective of the Development Framework

The main objective of the Development Framework for Offshore Wind Energy is to create an outline framework for the design, construction, availability and lifespan of the offshore grid.<sup>8</sup> It provides clarity in advance to offshore wind farm developers regarding the schedule and preconditions for the development of offshore wind energy in the Netherlands. Having clarity in advance is extremely important because, unlike the onshore high-voltage grid, the offshore grid is constructed specifically for offshore wind farms. As a result, choices made in terms of the design of the offshore grid generally have direct implications for the design and profitability of the connected wind farms. It is essential for offshore wind farm developers to be aware of these choices before they bid for a site in a wind farm zone.

The Development Framework broadly outlines the functional requirements and the technical concept for the offshore grid that the wind farms are connected to. The basic principles and intended objectives here are always to minimise total costs for offshore wind energy, i.e. the combined costs of the wind farms and the offshore grid.

The Development Framework also defines the task of the offshore grid operator, TenneT.<sup>9</sup> Based on Section 16e of the Electricity Act 1998, TenneT is obliged to draw up a document every two years that shows the offshore grid investments needed to implement this Development Framework. This is to ensure TenneT completes the connection of the wind farms in good time. Partly based on this Development Framework and prior to the construction phase of the offshore wind farms, TenneT is to conclude a Realisation Agreement and a Connection and Transmission Agreement<sup>10</sup> with the permit holders for the offshore wind farms, which further specify the technical details.

## 1.3 Assessment against the Development Framework

The third paragraph of Section 20d of the Electricity Act 1998 stipulates that the costs of investments made by TenneT for the offshore grid to implement the Development Framework will be included in the permitted incomes. This guarantees there will be no after-the-fact discussion of the extent to which investments made were useful and necessary. This shall not prevent the Netherlands Authority for Consumers & Markets (hereinafter referred to as the ACM) from monitoring and ensuring TenneT only recovers the rational costs for these investments.

## 1.4 Scope and updating of the Development Framework

The Development Framework relates to the offshore wind energy target of around 21 GW operating capacity by 2032.<sup>11</sup> In addition, a first step for the subsequent task is included. The stipulations in the Development Framework apply to the wind farm zones in the Offshore Wind Energy Roadmap; see Figure 1. The technical-functional specifications and the technical concept for the offshore grid apply to its entire service life. Where applicable, the Development Framework lays down specific stipulations for individual wind farm zones and the parts of the offshore grid relevant to them. For example, Section 4.2 of this Development Framework sets the delivery dates for the parts of the offshore grid relating to the various wind farm zones and the sites therein.

---

<sup>8</sup> As stated above, the Government informs the House of Representatives separately by letter regarding the Offshore Wind Energy Roadmap, which indicates when certain wind farm zones or parts thereof will be developed.

<sup>9</sup> On 5 September 2016, the Minister designated TenneT as the offshore grid operator.

<sup>10</sup> The contents of these agreements are known prior to the opening of the relevant tender.

<sup>11</sup> In the North Sea Programme 2022-2027, the Government decided to add a maximum of 10.7 GW to the original Roadmap 2030 for this.

The Minister will update the Development Framework should the situation require it. The basic principle here is that the functional specifications and the technical concept for the offshore grid do not change (in essence), so the standardisation (see Section 3.2) and cost savings that go hand in hand with this are ensured. This also gives wind farm developers certainty that they will not have to modify their design subsequently.

### **1.5 Content of the Development Framework**

Parts of this Development Framework have already been laid down or are still being elaborated on in subsequent policymaking, such as the North Sea Programme, the Offshore Wind Energy Roadmap and the Wind Farm Site Decisions. The following parts have already been laid down:

- The sequence for development of the wind farms. This sequence shows which zones must be developed first and those that will follow subsequently. The sequence is as laid down in the Offshore Wind Energy Roadmap; Chapter 2 provides a summary of the Roadmap;
- The way in which the wind farms are connected to the onshore grid: via the offshore grid. TenneT connects the wind farms and constructs and manages an offshore grid for this, with a view to a planned implementation and the realisation of cost savings. The basic principle for the offshore grid is also laid down in the Offshore Wind Energy Roadmap.

These decisions have, in fact, already taken a broad outline account of the integral consideration of the costs of the wind farms, spatial aspects and consequences for the offshore grid transmission system operator, as stated with regard to the Development Framework in the Electricity Act 1998. This Development Framework contains further elaboration of these broad outlines as well as a number of new elements. These elements are:

- Delivery dates for the various parts of the offshore grid; see Section 4.2 et seq. It is important that the connection for the wind farms is ready in time to prevent yield losses and damage to the wind farms. Overrunning the delivery dates set out in this Development Framework could be reason for TenneT to compensate the wind farm permit holder, in accordance with the provisions in Section 16f of the Electricity Act 1998;
- Further elaboration of the technical preconditions and functional specifications for the offshore grid. The Development Framework sets out the technical specifications with which the offshore grid must comply. These preconditions and functional specifications determine the technical design of the wind farms and thereby provide clarity and certainty for both TenneT and the offshore wind farm permit holders.  
In doing so, this Development Framework specifies the technical preconditions and functional specifications that determine the design and costs of the offshore grid. The detailed implementation of the preconditions and specifications, as well as the creation of technical-operational agreements, will be done by TenneT, in close cooperation with interested parties from the wind sector. Ultimately, the technical details and technical-operational agreements will be included in the Connection and Realisation Agreement that TenneT and the wind farm permit holders will enter into and in the technical codes (the conditions based on Section 31 of the Electricity Act 1998);
- The expected technical service lives assumed for the wind farms and the offshore grid.

### **1.6 Creation of this Development Framework**

Considering the importance of the Development Framework and the wider interests involved, the Development Framework has been prepared in consultation with TenneT, the wind sector (NedZero), ACM, and the ministries responsible for the North Sea, as well as the Ministry of Finance, which is a shareholder (on behalf of the state) in TenneT. An online consultation also took place prior to the first publication in 2016.

## 2 Sequence for development of the wind farms

### 2.1 Clustered realisation in designated Wind Farm Zones

During evaluation of a previous offshore wind tender round, it was concluded that there are cost benefits from developing offshore wind energy in clusters and when directed by the Government.<sup>12</sup> This was recognised when the agreements were made in the Energy Agreement, which are continued in the Climate Agreement and the Government's policy. In concrete terms, this means the realisation will occur in clusters per wind farm zone as designated in the North Sea Programme. Sites are designated for each wind farm zone by means of Wind Farm Site Decisions. Permits (and any subsidies) are issued using a tender procedure, in accordance with the Offshore Wind Energy Act.

For the phase before the Energy Agreement, wind farm zones where wind farms can be constructed at lowest cost were established, based on calculations by Energy Research Centre for the Netherlands (ECN).<sup>13</sup> These are the wind farm zones closest to the coast. The relatively short connections from the wind farms to the national high-voltage grid, in particular, and the advantage that they can be installed using relatively cheap alternating current technology, ensure the costs per kilowatt hour for wind farms close to the coast are lower than for wind farms situated further from the coast.

### 2.2 Offshore Wind Energy Roadmap

The Offshore Wind Energy Roadmap shows the order in which the Wind Farms Zones will be developed. The realisation of offshore wind energy started with the development of the Borssele (approx. 1.4 GW), Hollandse Kust (zuid) (approx. 1.4 GW), and Hollandse Kust (noord) (approx. 700 MW) Wind Farm Zones. These zones are located relatively close to the coast and are connected with alternating current. These are being followed by Hollandse Kust (west) (approx. 2.1 GW max), IJmuiden Ver (approx. 6 GW), Nederwiek (approx. 6 GW), Ten noorden van de Waddeneilanden (approx. 0.7 GW), and Doordewind Site I (approx. 2 GW max).

In 2024, the Government decided to include Nederwiek Site III, Doordewind Site I and Hollandse Kust (west) Site III in the current Roadmap.<sup>14</sup> Preparatory activities for Doordewind Site II, such as surveys which can run concurrently with those for Doordewind Site I, are being continued due to efficiency in the implementation. Ten Noorden van de Waddeneilanden has been designated as a preferred location for offshore hydrogen production demonstration project 2.<sup>14</sup>

Research for Site VIII (0.7 GW) in the southern part of the Hollandse Kust (west) Wind Farm Zone is ongoing via the Investigation of Offshore Wind Energy Landfall Options 2031-2040 programme (*Verkenning Aanlanding Windenergie Op Zee 2031-2040*, VAWOZ 2031-2040).<sup>15</sup> Landing energy requires sufficient connection capacity in the North Sea Canal Area, which is related to, among other things, the sustainability plans of Tata Steel. The Government is expected to decide on the final planning for the VAWOZ programme in 2026.

### 2.3. After the current Offshore Wind Energy Roadmap

In anticipation of the Partial Revision of the North Sea Programme 2022-2027, the development of a wind farm with a 2 GW direct current connection is now commissioned in this Development Framework. This concerns Doordewind Site II. This designation of Doordewind Site II is subject to change, because the location will only be designated or reconfirmed in the Partial Revision. If Doordewind Site II is not reconfirmed in the Partial Revision, this location may still change.

---

<sup>12</sup> Final report of the Offshore Wind Energy Task Force, May 2010. Please see <https://zoek.officielebekendmakingen.nl/blg-65611.pdf>.

<sup>13</sup> Parliamentary Paper 33 561, No. 12.

<sup>14</sup> Parliamentary Paper 35325, No. 8

<sup>14</sup> Parliamentary Paper 33 561, No. 58; in the preparatory phase, the electric landing is included as a fallback option. The landing is therefore also still part of the Development Framework.

<sup>15</sup> Parliamentary Paper 33561 No. 52

By awarding this order to TenneT, it can meet its contractual obligations, additional costs are avoided and any gap between the current 21 GW Roadmap and the subsequent rollout of offshore wind is kept as small as possible. This also follows the advice given regarding the North Sea 2050 Energy Infrastructure Plan and shared with the House of Representatives<sup>16</sup>: "It is therefore desirable to reach a decision in the short term about whether TenneT should be awarded contracts for additional projects on the current roadmap, including the Doordewind 2 project."

Table 1 and Figure 1 below summarise the sequence of development of the Offshore Wind Energy Roadmap towards the target of approximately 21 GW by 2032. In addition, a preview is given of the first wind farm thereafter.

---

<sup>16</sup> Parliamentary Paper 33561, No. 63

# Offshore Wind Energy Roadmap 21 GW

























Figure 1 Wind Farm Zones within the Offshore Wind Energy Roadmap

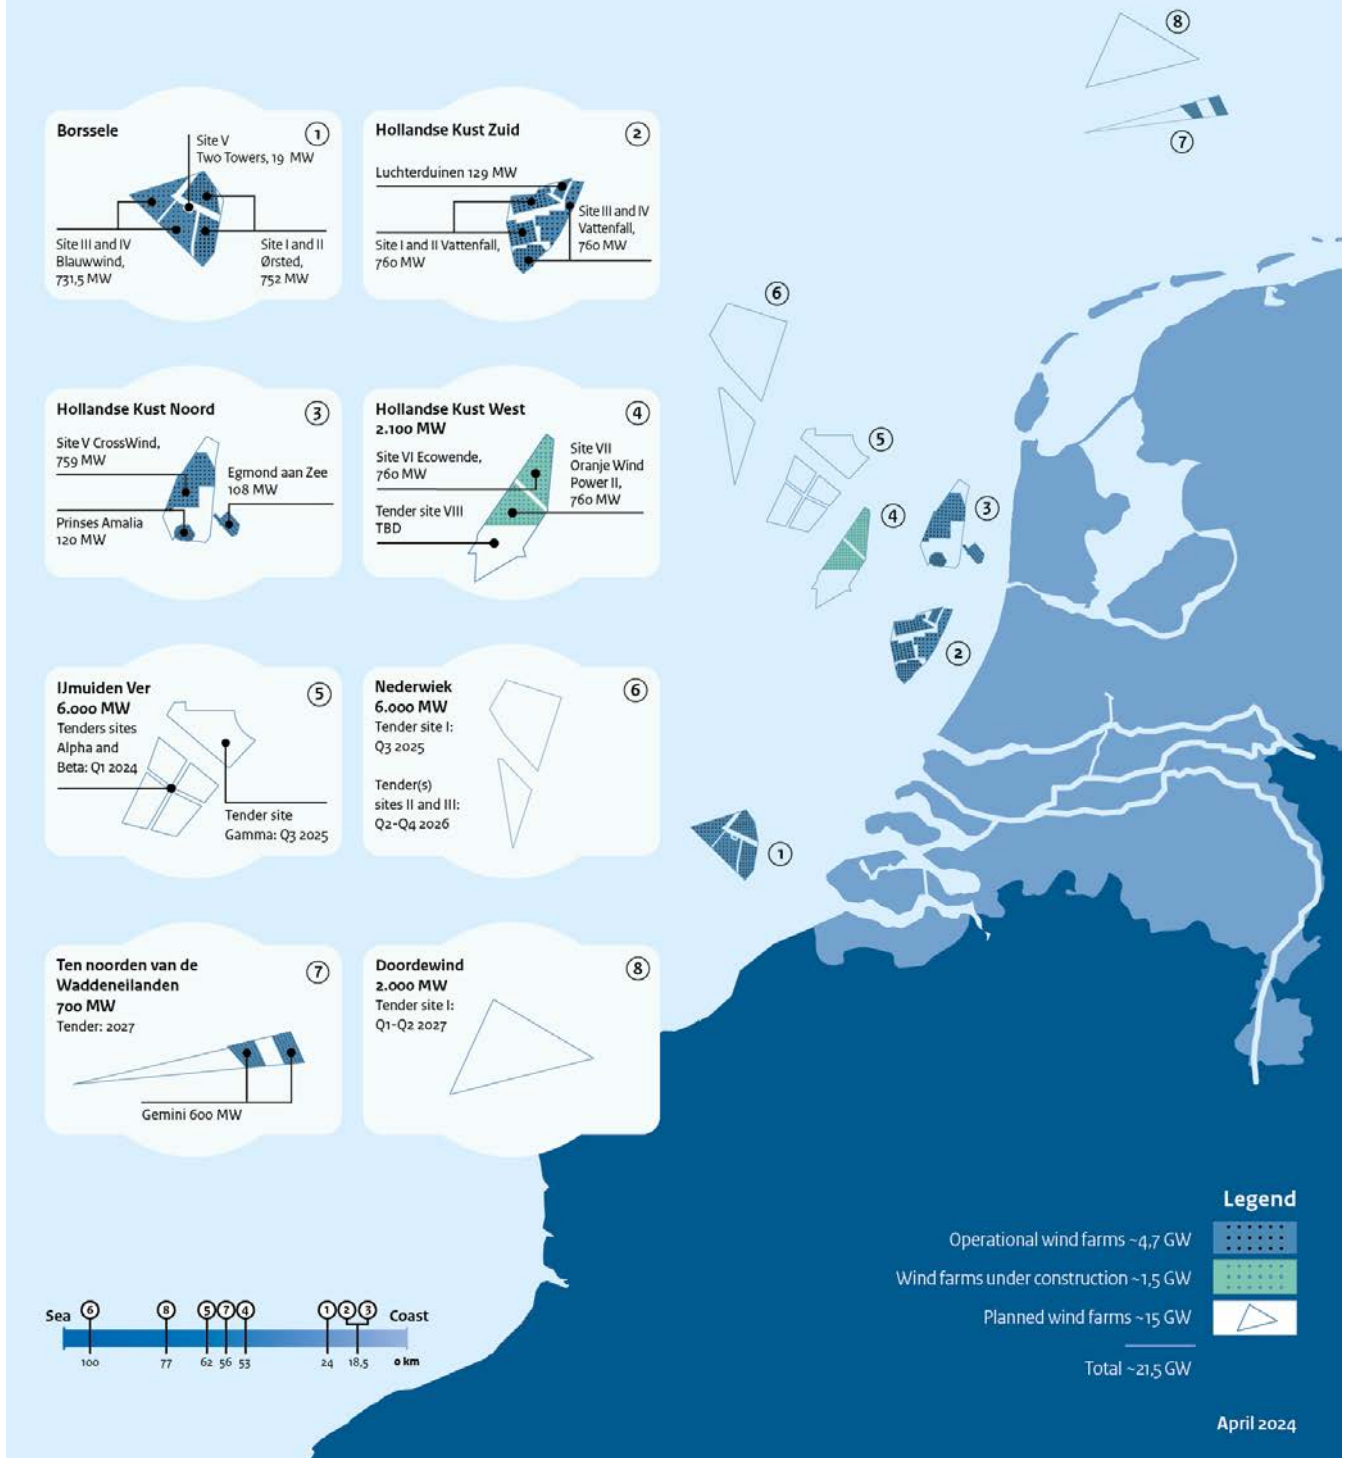**Table 1 Sequence for development of offshore wind energy**

Capacity (GW)	Wind Farm Site(s)	Tender for sites	(Expected) commissioning date of wind	Status
0.75	<i>Borssele</i> Sites I and II	Realised in 2016	2020	
0.75	<i>Borssele</i> Sites III, IV and V	Realised in 2016	2020	
0.76	<i>Hollandse Kust (zuid)</i> Sites I and II	Realised in 2017	2023	
0.76	<i>Hollandse Kust (zuid)</i> Sites III and IV	Realised in 2019	2023	
0.76	<i>Hollandse Kust (noord)</i> Site V	Realised in 2020	2023	
approx. 0.7	<i>Hollandse Kust (west)</i> Site VI	Realised in 2022	(2026-2027)	
approx. 0.7	<i>Hollandse Kust (west)</i> Site VII		(2027)	
approx. 2.0	<i>IJmuiden Ver</i> Site Alpha	Realised in 2024	(Q3 2029)	
approx.. 2.0	<i>IJmuiden Ver</i> Site Beta		(Q4 2029)	
approx. 1.0	<i>IJmuiden Ver</i> Site Gamma-A**	Q3 2025	(Q2 2031)	
approx.. 1.0	<i>IJmuiden Ver</i> Site Gamma-B**		(Q2 2031)	
approx. 1.0	<i>Nederwiek</i> Site I-A**		(Q4 2030)	
approx.. 1.0	<i>Nederwiek</i> Site I-B**	Q2 – Q4 2026	(Q4 2031)	
approx. 2.0	<i>Nederwiek</i> Site II	Q2 – Q4 2026	(Q2 2032)	
approx. 2.0	<i>Nederwiek</i> (Site III)		(Q4 2031)	
approx. 0.7	<i>Hollandse Kust (west)</i> Site VIII	TBC ***	(TBC)***	
approx. 0.7	<i>Ten noorden van de Waddeneilanden</i> Site I	TBC	(TBC)	
approx. 2.0	<i>Doordewind</i> Site I	Q1 – Q2 2027*	(Q4 2032)****	
approx. 2.0	<i>Doordewind</i> Site II (wind farm subject to change)*****	TBC	(2033)*	
 Realised:  Under construction:  Scheduled:				

\*Preliminary planning

\*\*As announced in the Letter to Parliament<sup>17</sup>, the original IJmuiden Ver Gamma and Nederwiek I sites have each been split from 2 GW sites to 2 x 1 GW (so 4 x 1 GW sites combined)

\*\*\*Hollandse Kust (west) Site VIII is expected to be completed after 2031. The 150 kV Velsen station is intended as the connection location for the power cable from Hollandse Kust (west) Site VIII. The availability of connection capacity and space at and to Velsen station is related to Tata Steel's sustainability process.

\*\*\*\*The landings of both Ten noorden van de Waddeneilanden Site I and Doordewind Site I are investigated in the Offshore Wind Energy Connection – Eemshaven Programme (PAWOZ – Eemshaven). The expected delivery date of these landings is therefore still uncertain.

\*\*\*\*\* Subject to reconfirmation in the Partial Revision of the North Sea Programme

<sup>17</sup> Parliamentary Paper 35561, No. 66.

## 3 Method of connecting the wind farms

### 3.1 Background

The Energy Agreement stipulates that, where this is more efficient than a direct, individual ("radial") connection of wind farms to the onshore grid, there should be an offshore grid to connect offshore wind farms with the onshore grid, for which TenneT will be charged with responsibility.

As the Minister stated in his letter of 18 June 2014,<sup>18</sup> a study by Royal HaskoningDHV, commissioned by the Ministry, revealed the construction of an offshore grid, managed by TenneT, has advantages over radial connections. The advantages are in the areas of availability (security of supply), planning coordination, financing burdens, standardisation, and associated cost reductions from advantage of scale for purchasing, maintenance, knowledge development, and learning effects. This model also simplifies compensating grid fluctuations, flow management, and balancing supply and demand, while integral grid operation also leads to knowledge pooling and a clear distribution of tasks and responsibilities in the electricity system. This also means TenneT can take advantage of the knowledge and experience gained through its German offshore activities.

In the aforementioned letter, the Government takes the directional decision to legally appoint TenneT as the transmission system operator for the offshore grid. The Electricity Act 1998 contains the legal basis for the appointment of TenneT and elaborates on a number of issues. In anticipation of the appointment, TenneT was temporarily charged with the legal duty of carrying out preparatory activities for the offshore grid based on the Electricity Act 1998.

As a result of the above, TenneT identified the costs of realising the offshore grid to implement the Energy Agreement and of taking on responsibility for the connections between the wind farms and the offshore grid.<sup>19</sup> It was concluded that substantial savings are possible by making TenneT responsible for all offshore infrastructure. DNV GL (now DNV) subsequently validated the technical concept and cost substantiation on behalf of TenneT.<sup>20</sup> This report was reviewed by ECN on behalf of the Ministry.<sup>21</sup> Like DNV GL, ECN concluded that coordinated connection of offshore wind farms by TenneT would lead to lower public costs than individual connections. The Minister's letters to the House of Representatives<sup>22</sup> about the costs of the offshore grid confirm this.

In September 2016, the Minister designated TenneT as the offshore grid operator.

### 3.2 Concept for the offshore grid

The basic principle behind the offshore wind energy assignment is to realise the wind farms in the most cost-effective manner. This is done by starting with a concept from TenneT for the offshore grid that is standardised as far as possible.<sup>15</sup> This concept uses substation platforms. In the case of alternating current platforms, approximately 700 MW of wind energy capacity can be connected to each platform.

---

<sup>18</sup> Parliamentary Paper 33561 No. 52


<sup>19</sup> Vision for Electricity Grid Design and Roll-out Strategy, Future-proof Electricity Grid Optimisation, TenneT, 21 July 2014.

<sup>20</sup> Review of Electricity Grid Design and Roll-out Strategy for TenneT Offshore Wind Farms, public version, DNV GL, 14 May 2014.

<sup>21</sup> Public version of validation of DNV GL document "Review of Electricity Grid Design and Roll-out Strategy for TenneT Offshore Wind Farms", ECN-N--14-020, 11 August 2014.

<sup>22</sup> Parliamentary Paper 33 561, No. 15, 19, 21 and 25.

When using direct current platforms, the connected capacity is approximately 2 GW. The wind turbines in the wind farms are connected to the platform; see Figure 2.

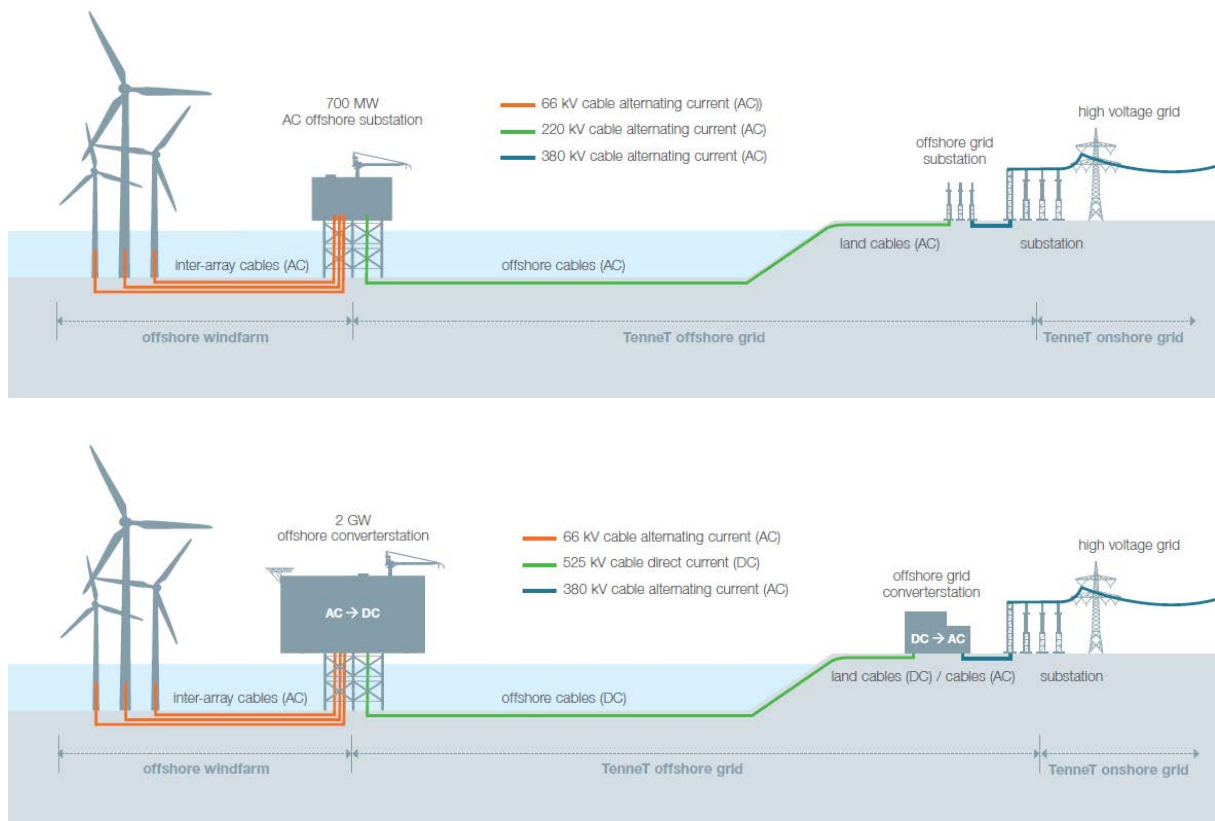

**Figure 2 Schematic depiction of the grid – alternating current (above) and direct current (below)**

The offshore grid comprises separate parts that connect the wind farm zones to the onshore national high-voltage grid. These parts will be constructed in phases, so each will be completed in time to transport the electricity generated by wind farms connected to that part.

This connection method reduces the number of platforms required compared with the situation in which each wind farm is connected to the national high-voltage grid by an individual platform and an individual connection. In addition to cost savings, the standardisation and bundling of connections will also minimise pressure on the environment by limiting disturbance to the landscape. There will also be benefits in terms of availability and it will be easier to meet the timetable in the Offshore Wind Energy Roadmap.

This offshore grid consists of the platforms, sea-based (energy export) cables, onshore cables, (the expansion of) an onshore substation and the connection to the existing onshore grid. In cases where direct current is used, the onshore converter substation and the cable connections will also form part of the offshore grid. What are known as the inter-array cables, which connect the individual wind turbines to TenneT's platform, are not part of the offshore grid, but rather are part of the wind farm.

### 3.3 Connection locations, connection methods and deep landings

#### 3.3.1 Connection locations and connection methods

The cables from the wind farm zones are connected to the onshore high-voltage grid at different locations. Table 2 below provides an overview. While still to be further investigated, the connection sites and cable routes for Hollandse Kust (west) Site VII, and the Ten noorden van de Waddeneilanden and IJmuiden Ver Wind Farm

Zones were selected after a broad survey process (Exploration of Offshore Grid Landing, VANOZ<sup>23</sup> and VAWOZ 2030<sup>24</sup>) with early involvement by public authorities, companies, and civil society organisations. The selection was made following studies into the impact on technology, costs, the environment, and future-proofing options. This resulted in a geographically distributed connection pattern, with connection points preferably located close to industrial clusters on the coast and avoiding, as far as possible, the need for investments in the onshore high-voltage network.

In the VANOZ process, which was later reconfirmed in VAWOZ 2030, it was decided to use conventional electrical connections. Non-electrical alternatives, for example involving the generated electricity being converted to hydrogen offshore before being transported ashore by means of a pipeline, proved to be unrealistic within the time frame of the 2030 Roadmap. These types of concepts are still in too early a stage of development to provide sufficient scale or cost competitiveness. Non-electrical options could, however, be considered for the period after 2030. A decision on their application has yet to be made.

**Table 2 Locations for connection to the onshore high-voltage grid**

Wind Farm Zone, Site(s)	Onshore connection site
Borssele, Sites I and II	Borssele
Borssele, Sites III, IV and V	Borssele
Hollandse Kust (zuid), Sites I and II	Maasvlakte
Hollandse Kust (zuid), Sites III and IV	Maasvlakte
Hollandse Kust (noord), Site V	Beverwijk
Hollandse Kust (west), Site VI	Beverwijk
Hollandse Kust (west), Site VII	Beverwijk
Ten noorden van de Waddeneilanden, Site I	Eemshaven
IJmuiden Ver, Site Alpha	Borssele
IJmuiden Ver, Sites Beta	Maasvlakte
IJmuiden Ver, Sites Gamma-A and Gamma-B	Maasvlakte
Nederwiek, Sites I-A and I-B	Borssele
Nederwiek, Site II	Maasvlakte
Nederwiek, Site III	Geertruidenberg
Hollandse Kust (west), Site VIII	TBC: North Sea Canal Area
Doordewind, Site I	Eemshaven
Doordewind, Site II	Eemshaven*

\* Subject to reconfirmation in the Partial Revision of the North Sea Programme.

When determining routes for the (sea and land based) transmission cables for the offshore grid, physical and legal considerations, cost-efficiency, and consequences for the environment are taken into account as part of the State Coordination Scheme (RCR: *rijkscoördinatieregeling*/project procedure). Separate environmental impact assessments will be drawn up for the grid connections (platforms, cables, and the onshore transformer and/or converter stations). The connection sites and cable routes will be determined by the Minister in a preferred alternative based on a comprehensive impact assessment which, in addition to environmental impact, also examines the impact of the alternatives in terms of cost, technology, and future-proofing. When

<sup>23</sup> See Parliamentary Paper 33561, No. 48, blg-879079 and <https://www.rvo.nl/onderwerpen/bureau-energieprojecten/lopende-projecten/hoogspanning/verkenning-aanlanding-netten-op-zee-2030>.

<sup>24</sup> See Parliamentary Paper 33561, No. 52.

deciding on a preferred alternative, the Minister will also take into account the responses of involved parties<sup>25</sup> to phase 1 of the environmental impact assessments and to the comprehensive impact assessment. Advice will also be sought from the independent Netherlands Commission for Environmental Assessment as well as regional authorities (provinces, municipalities, and water authorities).

This Development Framework stipulates that the construction method for the onshore sections of the offshore grid must be in accordance with the cabling method<sup>26</sup>, provided this is technically feasible. For the onshore parts of the offshore grid, any additional costs for underground construction are justified on the basis of the following considerations:

- Public support. The possible onshore substations are partly located in heavily populated areas, as a result of which the land routes of the offshore grid could have a major impact on the environment;
- Feasibility of the plan for realising the Roadmap and consequently the offshore wind agreements in the Energy Agreement and Climate Agreement. Previous projects for high-voltage connections have revealed that the lead time for integration procedures is considerably shorter because there is significantly less public resistance;
- Less space required and more flexibility in construction. An underground cable route requires less (protection) space than an above-ground route;
- Relatively short routes for the most part. The locations of the substation options being considered means the length of the land routes for the offshore grid will be limited. This minimises both total additional costs and technical consequences of cabling for the national high-voltage grid onshore.

For wind farm zones connected to more than one platform, this Development Framework stipulates that the onshore sections for the cables from both platforms can be laid simultaneously if it limits environmental impact is more cost-effective or for other valid reasons.

Given the relatively short distance from the wind farm zones to the onshore connection sites and the relatively limited size of the capacity installed, the offshore grid for the Borssele and Hollandse Kust Wind Farm Zones will be configured for alternating current. The same also applies to the Ten noorden van de Waddeneilanden Wind Farm Zone, although the distance from this Wind Farm Zone to an onshore connection site is at the limit of what is possible with alternating current. The IJmuiden Ver, Nederwiek and Doordewind Wind Farm Zones will be connected using high voltage direct current (HVDC) due to the relatively large distance to the onshore connection sites and the large capacity to be connected (approx. 4 to 6 GW each).

### 3.3.2 Deep landings

As explained in the Letter to Parliament on the Delta Rhine Corridor (DRC) of 5 December 2024<sup>27</sup>, it has been decided to limit the DRC to the modalities of hydrogen and CO<sub>2</sub>. The consequence is that alternative routes for the deep landing of offshore wind energy must be sought in a new deep landings research project. The need for deep landings remains: 1. from a grid system perspective and for the prevention of grid congestion on the AC network, spreading landings is strongly desirable; and 2. to meet the need for sufficient sustainable electricity outside the coastal zones. To this end, TenneT is asked to undertake preparatory activities for the development of one or more deep landings.

### 3.4 Platform locations and accessibility

This Development Framework stipulates that the locations of the platforms must be selected so they make an optimal contribution to lowering the total cost of the electricity generated by the wind farms concerned. Account must also be taken of other relevant interests, including existing electricity network routes, pipelines, telecommunications cables and interconnectors as well as archaeological interests. The initial search areas for platform locations are determined by the designation of sites in the Wind Farm Zones, which is done for the Wind Farm Site Decisions. The final locations are laid down in the Water Act (*Waterwet*) permit for each grid

---

<sup>25</sup> Anyone can respond to the comprehensive impact assessment by means of an internet consultation.

<sup>26</sup> Cabling means laying a high-voltage cable underground.

<sup>27</sup> Parliamentary Paper 29826, No. 216

connection. Depending on the final layout of the sites in the wind farm zones and final locations of the platforms, it could prove that, for cost-effectiveness, spatial or other reasons, following the preferred cable corridors of the North Sea Programme is not advisable.

### **3.4.1 700 MW alternating current connections**

This Development Framework stipulates that the standard method of accessing the 700 MW alternating current platforms of the offshore grid is by ship.<sup>28</sup> To this end, platforms should have facilities to increase accessibility to them by ship under various weather conditions, enabling safe landing of ships and transfer of personnel and equipment.

Based on a study commissioned by TenneT<sup>29</sup>, which was consulted on with the wind sector, this Development Framework stipulates that alternating current platforms will not be equipped with helicopter decks, with the exception of the alternating current platform for Ten noorden van de Waddeneilanden. This is based on the following arguments<sup>30</sup>:

- The platforms are located relatively close to the coast and ports, making time gained from accessibility by helicopter minimal.
- The amount of time when access by ship is impossible and a helicopter can provide added value is minimal, in view of the high availability of the offshore grid expected.
- Not having a helicopter deck results in cost savings of several million euros (both investment costs and operating costs, which combined make up approximately 0.1% of total costs).
- Increased space will be available for wind turbines, because there is no need for obstacle-free helicopter approach routes at the sites.
- The industry is increasingly using ships for offshore operations and maintenance activities instead of helicopters, due to the risk of serious accidents involving helicopters.

One possible disadvantage of the lack of a helicopter deck is that under unfavourable weather conditions (heavy seas) it could take longer to repair a grid fault or in the connection between wind turbines and the offshore grid. However, the probability of this is small and does not outweigh the savings. Moreover, platforms will be equipped with a heli-hoist facility<sup>31</sup>, which enables individuals and materials to be transported to and from the platforms in cases of particular urgency or disaster. The distance from the Ten noorden van de Waddeneilanden Wind Farm Zone to a departure port and local weather and sea conditions would limit accessibility and effective working time during transport by ship to such an extent that a helicopter deck is required in this case.

TenneT makes further agreements with wind farm permit holders for access to its alternating current platforms in Realisation and Connection Agreements. The basic principle here is to ensure workable access by the wind farm permit holders, within safety restrictions, to equipment and systems they own and which are housed on the TenneT platform for reasons of cost-effectiveness.

### **3.4.2 2 GW direct current connections**

In view of the relatively large distances to the coast, before the consultation process, TenneT carried out an extensive study<sup>23</sup> on the planned 2 GW direct current platforms. This looked into aspects such as offshore logistics and access to and exit from the platforms. Based on this study, this Development Framework has determined that a helicopter deck is necessary on each of the 2 GW direct current platforms and would contribute to minimising repair time in the event of failures and thus to higher availability of the connections. In addition to a helicopter deck, the platform will be fitted with facilities to increase accessibility by ship under various weather conditions, ensuring safe landing of ships and transfer of personnel and equipment.

<sup>28</sup> This also includes crew transfer vessels, platform supply vessels and “walk to work” solutions.

<sup>29</sup> High level review helideck and accommodation; Helideck and accommodation facilities on offshore platforms for wind farms, public version, DNV GL, report no. 130112-NLD-R1, Rev. A-Public, 9 June 2015. See <https://www.tennet.eu/information-wind-farm-developers>

<sup>30</sup> See TenneT consultation position paper “T.4 Access to platform”, see <https://www.tennet.eu/information-wind-farm-developers>

<sup>31</sup> A facility to lower and retrieve people and (to a very limited extent) goods from a helicopter by means of a winch.

The consultation process with wind farm developers suggested there is no added value to them in equipping platforms as logistics hubs. The current trend in offshore wind turbine operations and maintenance is evolving towards the use of service vessels that do not sail back and forth between the wind farm and the coast on a daily basis but remain at sea for long periods of time. Limiting access to the platform by third parties also contributes to a clear separation of responsibilities and to reducing additional investments. From a safety perspective, as well, it is preferable to minimise the number of hours spent on the platform.

The consultation process also showed it is possible to design the 2 GW direct current connections in a way that limits or prevents the platforms and the onshore substations being used to house equipment for wind farm developers. Note, TenneT does still provide space for this purpose. As a result, wind farm developers would not require access to the platform or onshore station during normal operations. This contributes to a clear separation in responsibilities between TenneT and wind farm developers and to reducing the need for additional investments.

During construction and commissioning of the wind farms, and in the event of equipment failures, access to TenneT's platforms by wind farm permit holders is necessary. For maintenance operations and when dealing with breakdowns, it should be possible for people to stay on the platform. TenneT will come to further agreements in this regard with wind farm permit holders in the Realisation and Connection Agreements. Once a platform is fully operational, it will be operated as an unmanned platform.

### **3.5 Availability and minimum guaranteed transport capacity**

The benefits of constructing the offshore grid should, among other things, be reflected in higher availability (reliability) of transmission capacity.<sup>32</sup>

#### **3.5.1 700 MW alternating current connections**

The alternating current platforms are each connected to the onshore high voltage grid with two 220 kilovolt cables. This offers additional availability, reducing the risk of partial or total interruption of transport capacity. In addition, the electrical installation on the side to which the wind turbines connect is set up in such a way that, even if one of the 220 kilovolt cables or the transformers connected to it fail, the wind farms can be switched to another offshore transformer. This also provides additional availability, allowing at least half of the transport capacity to remain intact.

The Borssele, Hollandse Kust (zuid), and Hollandse Kust (west) Wind Farm Zones each contain several alternating current platforms. A connection between platforms in the same wind farm zone will provide additional availability. A cost/benefits analysis commissioned by TenneT<sup>33</sup> shows the benefits of a 66 kilovolt connection outweigh the additional costs. This Development Framework therefore stipulates that there is to be a 66 kilovolt voltage level connection between the platforms in the aforementioned wind farm zones. This will ensure high availability, and diesel generators will not have to be installed on the platform as a back-up facility to condition the wind turbines in case of power failure. This does not appear to be common in the sector, with a comparable level of availability of an offshore wind farm grid connection.

The minimum guaranteed transmission capacity of the offshore grid is 700 MW per alternating current platform, unless specific (location) circumstances make this impossible. For the offshore grid from IJmuiden Ver Sites Gamma-A and Gamma-B, if there is a (temporary) lack of sufficient energy demand or if there are not

<sup>32</sup> See the Vision for Electricity Grid Design and Roll-out Strategy, Future-proof Electricity Grid Optimisation, 21 July 2014, Review of Electricity Grid Design and Roll-out Strategy for TenneT Offshore Wind Farms, DNV GL, 14 May 2014 and the Public version of the validation of DNV GL document "Review of Electricity Grid Design and Roll-out Strategy for TenneT Offshore Wind Farms", ECN-N-14-020, 11 August 2014.

<sup>33</sup> See the TenneT consultation position paper "T.12 Redundancy & Availability", [https://www.tennet.eu/fileadmin/user\\_upload/Our\\_Grid/Offshore\\_Netherlands/Consultatie\\_proces\\_net\\_op\\_zee/Technical\\_Topics/56\\_0\\_NL\\_15-216-T12\\_Redundancy\\_availability\\_PP\\_v2.pdf](https://www.tennet.eu/fileadmin/user_upload/Our_Grid/Offshore_Netherlands/Consultatie_proces_net_op_zee/Technical_Topics/56_0_NL_15-216-T12_Redundancy_availability_PP_v2.pdf).

enough options to resolve congestion issues via redispatch, it may not be possible to simply feed wind-generated electricity into the onshore grid. This may result in TenneT entering into conditional Transmission Agreements, whereby less than the minimum 700 MW transmission capacity is guaranteed, or other measures are required. This must be specified before tenders for the wind farm sites are opened.

### **3.5.2 2 GW direct current connections**

The direct current platforms will each be connected to an onshore converter station via two 525 kilovolt cables and a metallic return. The onshore converter station is then connected to the national high voltage grid. To ensure maximum availability, a bipolar configuration with a metallic return is used. The converter poles on the platforms can be cross-coupled to further increase availability.

For the direct current platforms in the wind farm zones concerned, TenneT will further investigate whether interconnection of the platforms is advisable and efficient; see also Section 3.9.

The guaranteed transmission capacity for the direct current platforms is 2 GW per platform. For the offshore grid from IJmuiden Ver Sites Gamma-A and Gamma-B, if there is a (temporary) lack of sufficient energy demand or if there are not enough options to resolve congestion issues via redispatch, it may not be possible to simply feed wind-generated electricity into the onshore grid. This may result in TenneT entering into conditional Transmission Agreements, whereby less than the above mentioned 2 GW minimum transmission capacity is guaranteed, or other measures are required. This must be specified before the tenders for the wind farm sites are opened.

### **3.5.3 Distribution in case of reduced transport capacity**

For both alternating current and direct current connections, the need to reduce transmission capacity to less than the guaranteed amount could arise for reasons of grid safety or due to, for example, the failure of a cable or a transformer. This reduction takes place across the connected wind farms in proportion to the bandwidths stated in the relevant Wind Farm Site Decisions for the total installed capacity<sup>34</sup> per site. The capacity that is ultimately installed at a site is therefore not decisive. TenneT is to include conditions for the reduction in capacity in its Connection and Transmission Agreements.

## **3.6 Maximum feed-in capacity of the wind farms**

From a cost-efficiency perspective, it could be beneficial to install more capacity than the guaranteed transport capacity. After all, the wind farms will not always run at full capacity, with the offshore grid transport capacity usually only partly used. By installing more wind power capacity ('overplanting'), more electricity can be generated and costs per unit of electricity (kWh) can be reduced.<sup>35</sup> This would contribute to achieving the intended cost reduction of offshore wind energy and Dutch carbon reduction targets.

There is, however, an optimum: at some point, during sustained periods of strong wind, generation from the installed wind capacity will exceed the guaranteed transmission capacity of the offshore grid to such an extent that an increasingly large proportion of the electricity can no longer be transported by TenneT. This could result in the need to shut down wind turbines. For each wind farm, however, this optimum capacity will depend on the type of wind turbine used, the space available for wind turbines and the increase in wake effects.<sup>36</sup> This means it is not possible to specify a single optimum wind farm capacity.

---

<sup>34</sup> Installed capacity: the capacity of the production installation that can be used for the generation of renewable electricity under normal conditions and is guaranteed by the supplier during continuous use (not including the capacity to be supplied temporarily by a booster).

<sup>35</sup> Allowing overplanting could increase the total subsidy required (where applicable) for offshore wind energy on the one hand, but there will be an increase in electricity production on the other. The costs per kilowatt hour would decrease.

<sup>36</sup> This refers to the mutual capture of wind by adjacent wind turbines.

### **3.6.1 700 MW alternating current connections**

Based on consultation meetings between TenneT and the wind sector, the Minister decided in 2015 that the maximum installed capacity for wind farms is to be 760 MW per alternating current platform.<sup>37</sup> This maximum installed capacity is laid down in the Wind Farm Site Decisions for the individual wind farms. Given our evolving understanding about maximising energy yields from wind farms and wind turbines, the possibility that an increased overplanting margin will be permitted in future Wind Farm Site Decisions cannot be ruled out.

As TenneT has configured the (security of) components in the platform design for the maximum 760 MW capacity originally determined by the Minister, it is necessary in this Development Framework to lay down that the maximum power input from the wind farms at the transfer point on alternating current platforms is 760 MW.

How much of the power produced in excess of the guaranteed transmission capacity can be transported by TenneT to the onshore high-voltage grid is also determined by the capacity of the cables.<sup>38</sup> TenneT has investigated the possibility of briefly providing additional transmission capacity by temporarily increasing the load on the cables (dynamic loading) during high winds. This possibility relies, in part, on cooling the cables, which in turn depends on seabed conditions. The size and duration of this temporary extra transmission capacity will therefore vary for each wind farm. TenneT publishes data on this prior to each tender for wind farm sites, so wind farm developers can make their own calculation of the expected availability of the temporary additional transport capacity.

The temporary additional transmission capacity is not a guaranteed offshore grid transmission capacity (as in the preceding section) and no rights may be derived in this respect. In the event of sustained overloading of the offshore grid, TenneT will ask wind farm permit holders to dial back the additional, non-guaranteed, capacity. If the connected parties do not comply with the instruction to reduce power output, TenneT will be forced to disconnect one or more 66 kilovolt connection (the inter-array cables) to reduce power output. As stated in Section 3.6, TenneT will include conditions for this in its Connection Agreement.

### **3.6.2 2 GW direct current connections**

In the case of wind farms connected to a direct current platform, increased electricity production can also be achieved using overplanting. There is, however, a key difference compared to alternating current connections: Given the nature of the direct current equipment, a (temporary) power input higher than 2 GW cannot be achieved, unlike for alternating current platforms. For direct current platforms, the maximum power input is therefore equal to the guaranteed transmission capacity, which is 2 GW per platform. It is, however, possible to use overplanting to produce (and transport) more electricity when there are lower wind speeds, as long as the total electricity produced does not exceed the guaranteed transmission capacity (of 2 GW).

As TenneT must take into account the load factor when designing the direct current platforms and cables, it is necessary for this Development Framework to determine the degree of overplanting it should take into account. In the consultation process with wind farm developers, a consensus was reached for a maximum overplanting percentage of 15%. This means TenneT must take into account a maximum installed wind capacity of 2.3 GW per direct current platform and the resulting higher load (load factor). The maximum installed capacity of the wind farms themselves will be laid down in the relevant Wind Farm Site Decisions.

---

<sup>37</sup> In his letter of 19 May 2015 (Parliamentary Paper 33 561, No. 19), the Minister stated that 380 MW was the maximum permitted capacity for each 350 MW site, or 760 MW for each 700 MW alternating current platform. The possibilities for overplanting are different for the direct current platforms. This was one of the subjects discussed during consultations with the wind sector in 2019. Decision-making in this regard is laid down in the relevant Site Decisions.

<sup>38</sup> TenneT guarantees a transport capacity of 700 MW per platform, see Section 3.5.

### **3.7 Wind turbine and export cable connections**

The transport capacity of the (the inter-array cable) connections from the wind turbines to the offshore substation is directly linked to the voltage level of cables used. Currently, the voltage level used in new wind farms is 66 kilovolts. This voltage level has cost and other advantages compared to the 33 kilovolts level used until recently. This was described in detail in the first version of this Development Framework.

The Minister has therefore informed the House of Representatives by letter<sup>39</sup> that the voltage level for (inter-array cable) connections of the wind farms under the Offshore Wind Energy Roadmap will be 66 kilovolts. This applies to both direct and alternating current platforms. This also means the offshore grid must be suitable for connecting wind farms at a voltage level of 66 kilovolts.<sup>40</sup> The 66 kilovolt installation on the TenneT platform (substation), up to the physical connection point with the inter-array cables that are part of the wind farm installation, is therefore considered to form part of the offshore grid.

#### **3.7.1 700 MW alternating current connections**

As a result of opting for a voltage level of 66 kilovolts, approximately 60 to 70 MW can be transported per inter-array connection. This also limits the number of J-tubes needed to route inter-array connections to the platform. Theoretically, with a capacity of 700 to 760 MW per wind farm (in the case of alternating current) and a capacity of 60-70 MW per inter-array connection, at least 12 J-tubes are theoretically required. However, during TenneT's consultation with the wind sector, it became apparent that a higher number of J-tubes is needed to provide sufficient flexibility in cabling the wind turbines, including in sites that are less favourably located. For this reason, this Development Framework stipulates that alternating current platforms will be equipped with 16 J-tubes per 700 MW wind farm. As well as these 16 J-tubes, there should be an extra J-tube for testing facilities<sup>41</sup> and an additional J-tube for the cable connecting the two platforms in the Wind Farm Zone.<sup>42</sup> This brings the total number of J-tubes for the inter-array connection side to 18. The number of J-tubes for the 220 kilovolt cables is two per alternating current platform.

#### **3.7.2 2 GW direct current connections**

The number of J-tubes for the 66 kilovolt cables on the direct current platforms is 30. Of these, 28 are for the wind farm permit holder. This is the result of consultation with wind farm developers and is based on the number of connection fields (see Section 3.8), the capacity per field (1250 amperes at 66 kilovolts) and the expected power capacity of the connected wind turbines (12 to 20 MW per turbine). The two remaining J-tubes can be used as spares or for other customer connections (see Section 3.10). Any other J-tubes not used by the wind farm permit holder can also be used for customer connections.

The 525 kilovolt cables require J-tubes for the connection to the shore and for a possible hybrid connection (see Section 3.9). As a result, 2 x 3 J-tubes will be required for the 525 kilovolt direct current cables and the metallic return as well as 2 J-tubes for fibre optic connections.

### **3.8 Electrical properties and protection**

The system formed by the wind farms and the offshore grid should function as efficiently as possible, so the yield of sustainable electricity is as large as possible.

<sup>39</sup> Parliamentary Paper 33 561, No. 19.

<sup>40</sup> Technical developments could make it appropriate to use a voltage of 132 kilovolts for inter-array cables in the near future. This is being investigated and requires a separate decision by the Minister.

<sup>41</sup> This also includes demonstration activities at an innovation site.

<sup>42</sup> This applies to the Borssele, Hollandse Kust (zuid) and Hollandse Kust (west) Wind Farm Zones.

### **3.8.1 700 MW alternating current connections**

TenneT's alternating current platforms include the following facilities:

- A facility to compensate for the reactive power of the 220 kilovolt cables, in addition to the facility present for this in the onshore station;
- Reactive power compensation of the inter-array connection cables should be done using the capabilities of the wind turbines.<sup>43</sup> To this end, TenneT supplies a reactive current setpoint the wind turbines can meet. This is considered to be fine-tuning. TenneT controls the broad steps for reactive power compensation by switching coils or capacitors at the onshore station. If the connected wind turbines should unexpectedly be unable to meet the requirements drawn up by TenneT in relation to reactive power compensation around zero-load, TenneT will adjust the reactive power management to this situation. However, the permit holder still remains primarily responsible for the reactive power compensation of its cables and turbines;
- Sufficient fields to connect the inter-array connections to the platform, but not an unnecessarily high number to limit the risk of unused fields. Given the anticipated number of at least 12 (66 kilovolt) inter-array connections for each 700 MW wind farm,<sup>44</sup> TenneT's electrical installation will have to factor in at least 12 switching fields per wind farm. If a wind farm nonetheless wishes to establish more connections (maximum of 16), two cables will be connected to one or two switching fields. It must be possible to separate individual cable connections from the overall inter-array connection network on a single switching field, in case of a fault on one of the cables. There should be a separate circuit for wind turbines in an innovation site, if there is one. TenneT is to set out further agreements about the operation of the fields and circuits in its Connection and Transmission Agreement. During TenneT's consultation process, there was unanimous agreement that TenneT should perform this operation, as is current practice for onshore connections. This Development Framework therefore stipulates this choice.
- TenneT will provide adequate space for housing the necessary computer and communication equipment and facilities for two-way data traffic for each wind farm, near the onshore substation to which the offshore grid is connected, as well as on the platforms themselves, and will make further arrangements with the wind farm permit holders in the Realisation and Connection Agreements. This will reduce the need for transport to TenneT's wind farms and alternating current platforms by allowing them to be operated largely remotely.

To make optimum use of the standardisation concept, an electrical protection system, with the general functional specification standardised by TenneT, will be used for the inter-array connections. The ownership, operation and maintenance of this system will rest with TenneT. As the owner of this standard installation, TenneT will bear the costs of ownership, operation and maintenance. TenneT will not pay for any deviations or additions to the standard installation for wind farms required by the permit holders.

### **3.8.2 2 GW direct current connections**

The direct current platforms will contain the following facilities:

- Each platform contains four 500 MW generator blocks. There are seven connection fields available for each generator block, giving a total of 28 connection fields. 24 connection fields are available as standard for the offshore wind farm. Two of the 24 connection fields will be able to connect two inter-array cables. The remaining four of the 28 connection fields are known as "extra connection fields". One of these extra connection fields is primarily reserved for connecting an electricity customer, but can also be made part of the connection to the wind farm for the input of non-wind energy from this wind farm, for example from

<sup>43</sup> The European Code for Generators (Requirement for Generators) requires that contemporary wind turbines must provide reactive current compensation at around zero load.

<sup>44</sup> The tenders for the Borssele and Hollandse Kust (zuid) Wind Farm Zones related to 350 MW sites, but since the tenders for Hollandse Kust (noord), these have been 700 MW sites (for alternating current connections). However, the technical requirements stipulated by TenneT in its Connection and Realisation Agreements are based on a layout of 2 x 350 MW.

alternative generation or storage (customer connection, see also Section 3.10). The three other extra connection fields are reserved for offshore wind farms.

- In the event that a 2 GW site is split into two 1 GW sites, both sites will have 12 connection fields available as standard for the wind farm. One extra connection field is reserved for both sites. In addition, a second extra connection field is reserved for one of the two sites. This means that one of the two wind farms can use a maximum of 13 connection fields (12 standard, 1 extra) and the other a maximum of 14 (12 standard, 2 extra). If the developer of the site with a maximum of 14 fields does not wish to use the 14th field, this will be offered to the developer of the other site. This does not apply to the 13th field. A period to be determined later to decide on the 14th field will be agreed between TenneT and the developer. The table below shows the distribution of these extra fields. If more 1 GW sites become available, this table can be supplemented.

Site	Number of additional connection fields available
IJmuiden Ver Gamma-A	2
IJmuiden Ver Gamma-B	1
Nederwiek I-A	2
Nederwiek I-B	1

- Unused extra connection fields reserved for the wind farms will be made available as customer connections, provided that a J-tube is also available for this. The costs for using an extra connection field, both for a customer connection and for an offshore wind farm, are borne by the connected party. This applies to both 2GW and 1GW sites. For the wind farm, a lower limit of 625 amperes will be used per connection field (half of the capacity per field) to prevent underutilisation of connection fields and to guarantee a balanced distribution of the power from the wind farm across the generator blocks.
- The platform will not have any reactive power compensation facilities for the inter array cables. The wind farm permit holder will be responsible for ensuring there is no exchange of reactive power at the physical connection point.
- In situations where there is no wind and the permit holder cannot meet the above provision, TenneT will provide reactive power compensation. This will be regulated in detail in the Connection and Transmission Agreements TenneT concludes with the permit holder.
- A fibre optic connection will be installed between nearby direct current platforms for two-way data traffic, so that in the unlikely event of a loss of connection to one platform, there is still full control over both the platform and the wind farms via the connection to the nearby other platform and the fibre optic connection.

The permitted harmonic distortion is set out in detail in the Electricity Grid Code (*Netcode elektriciteit*). TenneT determines the permitted emission limits at each transfer point and distributes the harmonic space between the connected parties. Further technical details may be included in the Connection and Transmission Agreements that TenneT concludes with the permit holder.

As with the alternating current platforms, direct current platforms will also use an electrical protection system for the connections, with general functional specifications standardised by TenneT. Ownership, operation and maintenance of this system will be with TenneT. As the owner of this standard installation, TenneT will bear the costs of ownership, operation, and maintenance. TenneT will coordinate on the safety configuration with the permit holder in the Connection and Transmission Agreements.

Unlike the situation for alternating current platforms, it is not envisaged that permit holders will install additional protection systems on the direct current platforms. The protection system on the direct current platforms is more comprehensive and has (multiple) back-ups, so additional systems are not necessary.

### 3.9 Hybrid connections

#### 3.9.1 Direct current connections are suitable for hybrid connections

As Section 1.1 explains earlier in this document, Section 16e of the Electricity Act 1998 requires that the Development Framework also takes into account future developments in offshore wind energy. For some time

now, experts and policymakers have been considering the (eventual) interconnection of connections for the wind farms in the North Sea and hybrid connections: connections between offshore wind farms combined with transmission between different countries.<sup>45</sup> This may eventually create a meshed grid in the North Sea. Such an international offshore grid can have certain benefits. The EU strategy for utilisation of the potential of renewable offshore energy<sup>46</sup> emphasises the crucial importance of developing a meshed grid to accelerate the roll-out of renewable offshore energy in a cost-efficient and sustainable manner. One characteristic of a meshed offshore grid are offshore energy hubs, which provide access to large-scale wind farms far out at sea. Energy hubs from different countries can be interconnected.

Hybrid connections are an intermediate step between national projects and a fully meshed offshore energy system and grid. Hybrid connections and a meshed offshore grid require far-reaching coordination between countries and parties. Discussions are currently ongoing about the development of such a grid in the North Sea, among other things, as part of the political declaration for cooperation between North Sea countries signed in 2016,<sup>47</sup> which was renewed at the end of 2021. Additional political declarations on cooperation based on the political declaration were drawn up in 2022 (Esbjerg, Denmark) and in 2023 (Oostende, Belgium).

Combining a connection (grid connection) of a wind farm with a transmission function in a hybrid connection can result in enhanced capacity utilisation of the connection and at the same time yield cost and space savings for the interconnector: much of the required infrastructure has already been constructed for the grid connection of the wind farm in question, after all. Expanding the interconnection capacity would contribute to further market integration and therefore lead to social benefits, including more stable electricity price development, integration of sustainably generated electricity, system flexibility and security of supply.

The possibility of hybrid connections requires an anticipatory investment: space will need to be reserved on the 2 GW direct current platforms to be able to connect an interconnector (in due course). The high-voltage installation will also have to be made suitable for future expansion with a hybrid connection. The Minister has already decided that, on balance, the expected social benefits of a hybrid connection with the United Kingdom are such that anticipatory investments in the platforms for IJmuiden Ver are justified. No new analysis has been performed for the subsequent direct current platforms.

However, the possibility of creating an additional connection also provides the option of interconnecting direct current platforms in the future, independently of the interconnection function, and possibly also afterwards, to make the offshore grid more robust. The increased redundancy improves security of supply. Further research will be required to make this possible, which will include investigating whether and how HVDC circuit breakers should be integrated in the offshore grid. These are still in development.

To safeguard the robustness and flexibility of the offshore grid, this Development Framework stipulates that TenneT must take into account extra space for an additional connection in the standard design for all direct current platforms. An investment decision regarding the development of such an additional connection will be taken separately. This will require agreement between parties that the European regulatory framework is suitable for the development of hybrid connections.

### **3.9.2 Preparing for offshore 'energy hubs' and hybrid connection to the UK**

The Letter to Parliament on offshore wind energy in the period 2030-2050<sup>48</sup> describes a number of planned developments for the offshore grid and announces the necessary preparations. For the period after 2030, the Government envisages a new way of constructing energy infrastructure for offshore wind: not specifically per wind farm but focused on large-scale offshore energy hubs. In these energy hubs, the electricity produced from surrounding wind farms is collected and partly converted into hydrogen. International hybrid connections with

<sup>45</sup> A transmission connection between different countries is also referred to as an interconnector.

<sup>46</sup> See <https://eur-lex.europa.eu/legal-content/NL/TXT/PDF/?uri=CELEX:52020DC0741&from=EN>

<sup>47</sup> [https://www.benelux.int/files/9016/3845/2539/NSEC\\_Political\\_Declaration\\_signed.pdf](https://www.benelux.int/files/9016/3845/2539/NSEC_Political_Declaration_signed.pdf).

<sup>48</sup> Parliamentary Paper 33561, No. 54.

(energy hubs of) other North Sea countries also originate from here. The Minister is drawing up a North Sea Energy Infrastructure Plan 2050 for the development of these energy hubs and international hybrid connections.

In the above-mentioned Letter to Parliament, the Minister concludes that it is necessary to retain TenneT as the grid operator for offshore electrical infrastructure for the period after 2030, and thus to give it a role in the development and realisation of energy hubs and international offshore hybrid connections. To this end, TenneT is asked to undertake preparatory activities for the development and connection of one or more energy hubs. In addition to these activities and building on what has been stated above about hybrid connections, TenneT was also asked in 2023 to make preparations for the development of a hybrid connection from the Nederwiek Wind Farm Zone to the United Kingdom.

### **3.9.3 Realisation hybrid link LionLink**

In the Development Framework of October 2023, TenneT was asked to make preparations for the development of a hybrid connection from the Nederwiek Wind Farm Zone to the United Kingdom (UK) (see 3.9.2). Progress has now reached the level whereby TenneT can take the next steps.

TenneT has concluded an agreement with British partner National Grid Ventures (NGV) to realise a connection from the platform for the wind farm at Nederwiek Site III to the UK main land by 2032. The Minister has noted that this 'hybrid' link to the UK, 'LionLink', delivers a positive contribution to Dutch society.

The House of Representatives passed the new Energy Law on 4 June 2024, which creates the possibility of developing hybrid connections as part of the offshore grid. As soon as the Energy Law comes into effect, TenneT can put a hybrid connection into operation. This Development Framework establishes that TenneT can make investment decisions to have LionLink operational in 2032.

### **3.10 Customer connections**

Through the legislative process for the Energy Act, work is underway to change the law to make it possible to connect electricity consumers to the offshore grid. This change in the law will also determine the conditions for connection and rates for customers.

Being able to purchase electricity from the North Sea stimulates the development of offshore innovations that can contribute to a more robust energy system, reduction of greenhouse gas emissions and a safer North Sea. For this reason, as outlined in Section 3.8.2, TenneT has been instructed to provide at least one connection field for a customer connection per direct current platform. In addition to purchasing electricity, this customer connection can also be used to feed in electricity. However, this customer connection cannot be used by the relevant wind farm permit holder for the feed-in of wind energy generated within the wind farm in question.

#### **3.10.1 Electrification of oil and gas platforms**

In the Offshore Wind Energy Roadmap 2030, the Minister set out the intention to investigate whether some oil and gas platforms could draw the electricity required for the facilities on those platforms from offshore wind farms. Such electrical connections would contribute to reducing carbon dioxide emissions (CO<sub>2</sub>), nitrogen oxides (NO<sub>x</sub>) and particulate matter emissions that result from gas extraction, as well as to more efficient use of the offshore grid.

A promising option is the electrification of gas platforms near the Hollandse Kust (noord) Wind Farm Zone through a connection to the offshore grid. The Minister has decided that an anticipatory investment in two additional connection fields on the platform in Hollandse Kust (noord) is justified. On this basis, this Development Framework stipulates that TenneT should include two additional connection fields during the construction of the alternating current platform for Hollandse Kust (noord).

Gas extraction is also taking place near the Ten noorden van de Waddeneilanden Wind Farm Zone and there is a real interest in connecting to the offshore grid. In contrast to the Hollandse Kust (noord) platform, there is no space available on the platform in Ten noorden van de Waddeneilanden for additional connection fields within the standard design, as the extra space here is required for the reactive power compensation equipment needed due to the relatively long export cable to the shore. Space can be created, however, by enlarging the

standard platform design. This Development Framework therefore stipulates that TenneT takes into account two additional customer connections when designing the alternating current platform for the Ten noorden van de Waddeneilanden Wind Farm Zone.

### **3.10.2 Reservation of customer connections**

Available connection fields for customer connections are relatively scarce. This can result in activities that represent a major public interest that may require a customer connection. Such activities usually require years of preparation before a decision can be made on the application for use of a customer connection. Due to the major public interest they represent, a reservation in this Development Framework prevents another activity from prematurely claiming the required customer connection, which would make further development impossible.

The Coast Guard's first offshore hydrogen demonstration project and offshore charging points for electric ships are developments that can be regarded as projects of major public interest. The offshore hydrogen demonstration project will be an important milestone in the diversification of the energy we generate in the North Sea and thus contributes to a more efficient energy system. The Coast Guard is preparing a tender to purchase electric ships that will contribute to the protection of energy supply, shipping and infrastructure with electric charging points spread across the North Sea.

The reservation expires when the customer connection is put into use by that activity or when it appears that the use of the customer connection is no longer necessary for various reasons. The expiration of a reservation will be announced via [an updated] publication of this Development Framework with a revised version of the table below.

#### **Reserved connection fields for customer connections**

<b>Activity</b>	<b>Platform(s)</b>	<b>Number</b>
First offshore hydrogen demonstration project	Hollandse Kust (noord)	1
Coast Guard charging points for electrical ships	TBC	TBC

### **3.11 Measuring electricity yield**

Agreements on measuring electricity yields from the wind farms are important for determining the wind farms' contribution to renewable energy objectives and for the possible eligibility of wind farm permit holders' to the SDE++ subsidy. In view of the economic benefits due to, among other things, logistics, the Electricity Metering Code<sup>49</sup> stipulates that parties connected to an offshore platform with a connection to the offshore grid and the operator of the relevant offshore platform (TenneT) jointly designate a metering manager for all the connections to the offshore platform concerned. The measurements of all the connections of a single wind farm will be combined to determine the amount of electrical energy (yield) at the point of feed-in to the public grid.

### **3.12 Shared services and nature-inclusive design, clean, emission-free construction and corporate social responsibility**

<sup>49</sup> As amended by a decision of the Netherlands Authority for Consumers & Markets of 14 May 2019, reference ACM/UIT/510948, amending the conditions referred to in Section 31 of the Electricity Act 1998 concerning responsibility for metering on connections to the offshore grid, Government Gazette No. 26779, 15 May 2019.

In addition to the wind farm operators and TenneT, other parties such as the Coast Guard, various port companies and the Royal Dutch Meteorological Institute (KNMI) would like to make use of the opportunities offered by the TenneT platforms, for example, for taking measurements or for installation of communication tools. TenneT will provide minimal facilities for this (space, antenna mast, fibre optic connection, electricity) on its platforms and onshore stations for the necessary equipment, insofar as this is reasonably possible within the existing design. The Directorate General for Public Works and Water Management (Rijkswaterstaat) will purchase these shared services and manage and maintain them. This will contribute to achieving the lowest possible social costs. Rijkswaterstaat is drawing up a business plan for this. Costs will be charged to the parties concerned, through Rijkswaterstaat.

To fulfil the commitment in the Climate Agreement to take additional broader measures to improve the conservation status of vulnerable species, taking into account their biotopes, and to reduce negative effects on the natural environment (such as biodiversity), TenneT will adopt a nature-inclusive approach to designing and constructing the offshore grid as much as is reasonably possible.

These measures should be proportionate to the efforts made by wind farm permit holders, pursuant to a best-efforts obligation or condition in the Wind Farm Site Decision concerned, to design and build the wind farm in such a way that it actively enhances the sea's ecosystem, helping to foster conservation efforts and goals relating to strengthening sustainable use of species and habitats that occur naturally in the Netherlands. The measures to be implemented will be assessed for each project in terms of technical feasibility, risk, cost and project-specific circumstances (project phase and location).

The Government considers it important that TenneT produces as few harmful emissions as possible when constructing the offshore grid. Under the coordination of the Minister of Infrastructure and Water, a Clean and Emission-Free Construction (*Schoon en Emissieloos Bouwen*, SEB) Roadmap, under the associated SEB Agreement, was , developed and signed on 30 October 2023 . Through the SEB Agreement, the Government, participating local authorities, sector parties and knowledge institutions make agreements about the implementation of the SEB Roadmap. This programme implements emission reduction targets (CO<sub>2</sub>, NO<sub>x</sub> and particulate matter) for work, vehicles and vessels in construction. The NO<sub>x</sub> emission reduction to be achieved is 60% compared to 2018 per kilometre of cable laid. The CO<sub>2</sub> emission reduction target is 42%, to be achieved by applying 60% sustainable energy carriers via a phase-in growth path.

TenneT is constructing the offshore grid in accordance with the SEB Agreement. The additional costs associated with complying with the SEB Agreement are considered useful and necessary. This does not affect the fact that ACM ensures that TenneT is only allowed to recoup the efficient costs for these investments.

The Government considers it important that TenneT acts in line with European regulations such as the Corporate Sustainability Reporting Directive ("CSRD", Directive 2022/2464), Corporate Sustainability Due Diligence Directive ("CSDDD", Directive 2024/1760) and Net-Zero Industry Act, and Dutch policy on International Responsible Business Conduct (IRBC). Given the international supply chain involved in the production of the 2 GW portfolio, it is even more relevant for the 2 GW portfolio to maintain sufficient focus on responsible business practices, with an eye for human rights, material use and circularity, working conditions and environmental impact. TenneT has therefore signed up to the IRBC Agreement for the Renewable Energy Sector, which was developed under the leadership of the Social and Economic Council of the Netherlands (SER) and of which many parties from the wind industry are members. This contributes to the definition of relevant and effective, additional measures in the local (national and international) context. The additional costs associated with implementing measures related to these European directives are deemed to be useful and necessary. This does not affect the fact that ACM ensures that TenneT may only recover the efficient costs for these investments.

### 3.13 Requirements for suppliers

TenneT contracts market parties for the construction and maintenance of the offshore grid. This includes, for example, the construction of platforms, production of cables and supply of (high-voltage) equipment.

The offshore grid is critical energy infrastructure. Suppliers for the offshore grid, either on their own or as part of a consortium, must therefore comply with the requirements and goals set out in the National Security Strategy 2019 and any updates, such as the midterm review 2021.

The Minister for Climate and Energy Policy has designated certain parts of the offshore grid (the 2 GW direct current connections) as critical or essential services in the context of protecting processes critical to national security<sup>50</sup>. TenneT will comply with all resulting requirements when contracting suppliers.

---

<sup>50</sup> Parliamentary Paper 30 821, No. 176

## 4 Time frame

### 4.1 Wind farm commissioning timeline

To meet political agreements on development of offshore wind energy as speedily as possible, it is important the wind farms are built and commissioned as soon as possible after the permit has been awarded. The various tender regulations stipulate that a wind farm must be fully operational no later than five years<sup>51</sup> after the (subsidy) decision.

### 4.2. Delivery dates for the offshore grid

To make full use of offshore wind, it is important the grid is ready on time and the wind turbines can be connected to it. At the same time, grid construction requires due care and a realistic timetable. With respect to planning and implementation, TenneT and the Ministry aim to ensure the necessary permits for offshore grid construction are irrevocable or final before TenneT awards the major contracts (e.g. for development of the platform and cable).

The development of the offshore grid for the IJmuiden Ver, Nederwiek and Doordewind Wind Farm Zones will be accelerated to achieve the increased target for approximately 21 GW by 2032 within the context of reducing CO<sub>2</sub> emissions by at least 55% in 2030 (see also Section 1.1). Due to the accelerated development and increasing pressure towards 2032 throughout the supply chain, TenneT needs to apply a different procurement strategy. For this reason, TenneT has bundled orders for the construction/manufacture of platforms, cables, HVDC equipment and onshore converter stations for the above-mentioned parts of the offshore grid.

It was already agreed in the Climate Agreement that, to achieve a higher CO<sub>2</sub> reduction target of at least 55%, TenneT would have to award contracts before final permits are obtained. Now this higher ambition has been set by the Government, this Development Framework stipulates that – to meet intended delivery dates for parts of the offshore grid stated in Section 16e of the Electricity Act 1998 under g – TenneT can award contracts before the final and irrevocable permits for the aforementioned sections of the offshore grid have been obtained.

This does not alter the fact that decisions on individual project budgets are made by the Ministry of Finance using project budget applications (PBAs) and the statutory processes that apply to them, and that ACM determines the permitted income for TenneT as the offshore grid operator and assesses the inclusion thereof in TenneT's annually proposed rates in accordance with the legal procedures (see also Section 5.1).

#### 4.2.1 700 MW alternating current connections

Based on the timetable for the tenders, anticipated construction times for the wind farms, TenneT's experiences with building platforms and experiences with the time required for permit procedures, Table 3 shows the offshore grid delivery dates for connecting wind farms for which a tender has already been issued or will be shortly. The delivery date is the day on which the relevant part<sup>52</sup> of the offshore grid is ready for the electrical commissioning of the connection for the wind farms concerned.

<sup>51</sup> The basic principle is that the wind farms should be operational within four years after the subsidy grant has been obtained. Section 14 of the Offshore Wind Energy Act consequently stipulates that a permit can only be granted if, based on the application, a sufficiently plausible case has been made that the construction and operation of the wind farm can commence within four years of the date on which the permit becomes irrevocable. This entails advance evaluation of the feasibility of that time frame. To provide some freedom in the actual realisation to compensate for unexpected occurrences, it has been decided to adopt a period that is one year longer in the regulations relating to the decision. In the case of a subsidy, the subsidy term of 15 years starts after five years.

<sup>52</sup> The relevant part of the offshore grid is understood to mean the assembly of components that are required for the wind farm concerned to be able to function fully. For example, for Sites I and II of the Borssele Wind Farm Zone, this means that the Borssele Alpha platform to which the wind farms on these sites will be connected is ready, but that the Borssele Beta platform does not have to be ready yet.

**Table 3 Delivery dates for the alternating current connections of the offshore grid**

Site	Delivery of offshore grid sections
Borssele Sites I and II	31 August 2019
Borssele Sites III, IV and the innovation site (V)	31 August 2020
Hollandse Kust (zuid) Sites I and II	31 December 2021
Hollandse Kust (zuid) Sites III and IV	31 March 2022
Hollandse Kust (noord) Site V	31 March 2023
Hollandse Kust (west) Site VI	31 March 2024
Hollandse Kust (west) Site VII	31 March 2026
Hollandse Kust (west) Site VIII	TBC
Ten noorden van de Waddeneilanden Site I	TBC

This means the electrical installation on TenneT's platform has been built in accordance with the required functionality, as set out in this Development Framework, and is ready for the electrical connection of the wind farms, after which the testing and commissioning period for the wind farms at the aforementioned sites will commence. In addition, it must also be possible for duplex data traffic (data transmission) for SCADA and metering systems to take place between the areas TenneT makes available to the wind farm owner on the onshore substations and on the alternating current platform. These areas should be suitable for the intended purpose. It goes without saying that, on the delivery date, the cable between the relevant platform and the onshore high-voltage grid will also provide the minimum guaranteed transport capacity, with the connection to the onshore high-voltage grid being technically capable of transporting this quantity of electricity.

The Completion Certificate for the relevant part of the offshore grid is based solely on that part being ready in time, including the 66 kilovolt installation. This provides a clear delivery time and avoids waiting for the first moment when the full guaranteed transport capacity is actually used. After all, wind farms are usually commissioned in stages, so this could take months. The Completion Certificate will be issued by an independent expert on behalf of TenneT. A standard operating procedure for the Completion Certificate will be drawn up by TenneT and the independent expert, in consultation with the Ministry and wind farm developers. The chosen procedure and experience gained during delivery of the first part of the offshore grid (the grid connections for Borssele Sites I and II) serve as a basis for this.

If TenneT completes the relevant part of the offshore grid later than the stated delivery date, a right to compensation may arise for the wind farm permit holders under the scheme, in accordance with Section 16f of the Electricity Act 1998. The right to due to late delivery expires at the time of delivery. After this time, there is only a right to compensation for non-availability of the offshore grid, in accordance with the aforementioned Section 16f. It is important to clearly record this moment to avoid questions about what type of losses can be claimed (losses due to delay or as a result of non-availability).

#### 4.2.2 2 GW direct current connections

Delivery of the planned direct current connections requires a separate procedure, given that, unlike alternating current connections, the entire wind farm needs to be connected and operational to allow testing of the direct current connections at full power. There is therefore greater interdependence between the offshore grid and the wind farms connected to it. Four dates are important here:

0. The date on which TenneT's platform is ready for the 66 kV cables of the wind farm to be retracted and secured on the cable deck ('mechanical cable pull-in') before the electrical connection can begin. This date is an obligation for TenneT.<sup>53</sup>
1. The date on which TenneT's platform is ready to receive and electrically connect the 66 kV cables from the wind farm ("cable pull in"). On this date, the offshore grid will be ready to power the wind farm and provide transmission capacity. This is also when the test phase for the joint system (wind farm and

<sup>53</sup> This Date 0, 'mechanical cable pull-in', is not specified for all wind farms. If it is not specified, TenneT will determine this in its Realisation Agreement and/or Connection and Transmission Agreement. This second variant of Date 0 therefore has a different status.

direct current connection) begins. At this stage, transmission capacity cannot yet be fully guaranteed. This date relates to an obligation on TenneT.

2. The date on which the wind farm permit holder(s) will have withdrawn all 66 kV cables on the platform and completed the connection to the platform, so TenneT can start the final part of the testing and commissioning phase start, i.e. testing at full capacity. In practice this means that:
  - a. At least 70% of the guaranteed transmission capacity of the direct current platform is connected to wind farm output (or at least 1.4 GW in case of 2 GW sites and 0.7 GW in case of 1 GW sites) and that all 66 kV cables of the wind farm have been connected and put into use;
  - b. The wind farm must be able to supply full power.
  - c. Moments 2a and 2b usually coincide in time. As an exception, to give the wind farm permit holder as much time as possible to install all wind turbines and make the connections, moment 2b can take place at a later time. This is indicated in Table 4 below. These dates concern obligations for the permit holder(s) of the wind farm.
3. The date on which TenneT must have completed the entire offshore grid for the relevant wind farm sites. Testing of the direct current connection will have been completed by this date, or in the case of 1 GW sites, completed per 1 GW. From this date, the minimum guaranteed transport capacity should be available. This is also the date on which a right to compensation may arise under Section 16f of the Electricity Act 1998, on the understanding that the right to compensation due to delayed delivery shall lapse upon delivery. After this time, there only remains a right to compensation for non-availability of the offshore grid, in accordance with the aforementioned Section 16f. This date relates to an obligation on TenneT.

**Table 4 Delivery dates for direct current connections for the offshore grid**

<b>Wind Farm Site</b>	<b>Date 0: Platform ready for mechanical cable pull-in</b>	<b>Date 1: Platform ready for electrical cable pull-in</b>	<b>Date 2: Wind farm ready to deliver full power</b>	<b>Date 3: Completion of DC connection</b>
<i>IJmuiden Ver Site Alpha</i>	N/A	1 March 2029	31 August 2029	31 December 2029
<i>IJmuiden Ver Site Beta</i>	N/A	31 May 2029	2a: 31 October 2029 2b: 30 November 2029	31 January 2030
<i>IJmuiden Ver Site Gamma-A</i>	N/A	30 April 2030	30 April 2031	31 July 2031
<i>IJmuiden Ver Site Gamma- B</i>	N/A	30 April 2030	30 April 2031	31 July 2031
<i>Nederwiek, Site I-A</i>	N/A	31 March 2030 <sup>54</sup>	31 December 2030	31 March 2031
<i>Nederwiek Site I-B*</i>	TBC	TBC	TBC	TBC
<i>Nederwiek Site II*</i>	N/A	TBC	TBC	TBC
<i>Nederwiek Site III*</i>	TBC	TBC	TBC	TBC

<sup>54</sup> In the period between Date 1 and Date 2, a maximum of six consecutive months may be used for commissioning activities by the wind farm developer. If this period does not start immediately after Date 1, Date 1 will shift in such a way that the start of this six-month period directly follows Date 1, but not earlier than 31-03-2030 and not later than 31-06-2030. This six-month period will be determined well in advance of the installation period in consultation with the offshore grid operator.

<i>Doordewind Site I*</i>	TBC	TBC	TBC	TBC
<i>Doordewind Site II**</i>	TBC	TBC	TBC	TBC
<i>* Exact delivery dates will be announced when the tender regulations (Ministerial Orders) for the relevant sites are published.</i> <i>** Subject to reconfirmation in the Partial Revision of the North Sea Programme.</i>				

#### 4.2.3 Delivery dates in relation to tenders and commissioning of wind farms

Before publication of the final tender regulations (Ministerial Orders) for future wind farms, final delivery dates are laid down in Tables 3 and 4 (above) of this Development Framework and announced to the bidding parties. Until then, Tables 5 and 6 (below) show indicative delivery dates for parts of the offshore grid belonging to (sites in) wind farm zones for which tenders will be held in the future. No rights can be derived from Tables 5 and 6.

After a tender for one or more sites in a wind farm zone has been successfully completed, TenneT will consult with the wind farm(s) permit holder(s) on further agreements, including agreements on the timetable for construction of the wind farm(s) and the respective part of the offshore grid and the (joint) testing phase.

For the dates referred to in Section 4.2.2 and Table 4, a delay in delivery by TenneT or the wind farm permit holder may not make it impossible for the other party to meet the subsequent delivery date. TenneT and/or the permit hold holder can therefore submit a request to the Minister to deliver part of the offshore grid or the offshore wind farm at a later date. In both cases, the request must be accompanied by a statement of no objection from the other party (TenneT or the wind farm permit holder). In its assessment, TenneT will, among other things, take into account the framework of the Public Procurement Act as well as any consequences for the preparation and/or realisation of other connections to the offshore grid. As a result of the request, the dates stated in Tables 3 and 4 for the relevant part of the offshore network may be moved back.

There is a possibility that permit(s) for the construction and operation of an offshore wind farm will become irrevocable considerably later than expected due to a potential appeal and objection procedure. If the period between the permit becoming irrevocable and the delivery date stated in Table 4 for when the platform is ready for electrical cable pull-in is considerably shorter than could reasonably be expected at the time of registration for the permit procedure, the Minister will, in consultation with TenneT and the permit holder(s), determine a new schedule for the milestones for the grid and offshore wind farm. In that case, the Minister may, on the basis of Section 15(4) of the Offshore Wind Energy Act, make use of the option to grant an exemption from the periods stated in the permit for the offshore wind farm.

**Table 5 Indicative delivery dates for the alternating current connections of the offshore grid<sup>55</sup>**

Wind Farm Site	Indicative delivery of parts of the offshore grid
Hollandse Kust (west) Site VIII	TBC
Ten noorden van de Waddeneilanden Site I	TBC

<sup>55</sup> Exact delivery dates will be announced when the tender regulations (Ministerial Orders) for the relevant sites are published.

**Table 6 Indicative delivery dates for the direct current connections of the offshore grid<sup>53</sup>**

<b>Wind Farm Site</b>	<b>Date 0: Platform ready for mechanical cable pull-in</b>	<b>Date 1: Platform ready for electrical cable pull-in</b>	<b>Date 2: Wind farm ready to deliver full power</b>	<b>Date 3: Completion of DC connection</b>
<i>Nederwiek Site I-B</i>	N/A	31-03-2031 <sup>56</sup>	31-12-2031	31-03-2032
<i>Nederwiek Site II</i>	N/A	30-06-2031	30-06-2032	30-09-2032
<i>Nederwiek Site III</i>	31-12-2030	31-03-2031	31-12-2031	31-03-2032
<i>Doordewind Site I</i>	31-12-2031	31-03-2032	31-12-2032	31-03-2033
<i>Doordewind Site II</i> * <sup>57</sup>	31-12-2032	31-03-2-33	31-12-2033	31-03-2034

\*Subject to reconfirmation in the Partial Revision of the North Sea Programme

<sup>56</sup> In the period between Date 1 and Date 2, a maximum of six consecutive months may be used for commissioning activities by the wind farm developer. If this period does not start immediately after Date 1, Date 1 will shift in such a way that the start of this six-month period directly follows Date 1, but not earlier than 31-03-2031 and not later than 31-06-2031. This six-month period is set well in advance of the installation period in consultation with the offshore grid operator.

<sup>57</sup> In April 2024, the Minister announced that Doordewind Site II would no longer be developed under the Additional Offshore Wind Energy Roadmap 2030, but moved to a date after then. The delivery dates are therefore still to be determined.

## 5 Lifespan and depreciation of the offshore grid

### 5.1 ACM determines the depreciation period for the offshore grid

The ACM regulates TenneT's income and also determines the depreciation periods that TenneT is allowed to use to pass on the costs for the offshore grid.<sup>58</sup> ACM determines the depreciation period for each five-year regulation period in the Method Decision. The 2017-2021 Method Decision states that the depreciation period for the offshore grid is 20 years. In the 2022-2026 Method Decision,<sup>59</sup> ACM has extended the depreciation period by 10 years for the assets of the offshore grid operator for the wind farms for which permits still need to be granted, so the period has increased from 20 to 30 years. In concrete terms, this involves the Hollandse Kust (west) wind farm sites and subsequent wind farms.

### 5.2 Required minimum lifespan of the offshore grid

Given the offshore grid supports the wind farms, the lifespan of the wind farms will initially determine the minimum lifespan for the offshore grid. This Development Framework assumes the offshore grid will be removed as soon as the connected wind farms are dismantled and removed (decommissioned) after the end of their permit period. Whether new wind farms are subsequently developed in the wind farm zones, for which the offshore grid can be reused, depends on developments in offshore wind (and the associated cost) in the next 30 to 35 years compared to alternative sustainable energy sources, as well as on the need and political will to implement incentives or other policies in this regard. These long-term developments are difficult to predict. An additional uncertainty is whether the limits of the technical design of the current offshore grid, with a maximum transmission capacity of 700 MW per alternating current platform and 2 GW per direct current platform and a voltage of 66 kilovolts for the connections, will be sufficient for future wind farms. Given the rapid technological development of offshore wind, it is conceivable that it may be wiser to completely replace or upgrade the entire offshore grid with state-of-the-art technology at the time, or to transport the energy generated to shore using non-electrical means.

#### 5.2.1 Aligning the lifespan and permit period of offshore wind farms

Until the mid-2010s, the anticipated lifespan of an offshore wind farm was generally 20 years. This stems from the manufacturers' certified lifespan for wind turbines, which wind farm developers use in their business cases. An economic service life of 20 years was also factored in when determining the maximum amounts for the tender procedures with a subsidy.<sup>60</sup> It was assumed the permit holders would have their wind farms continue to produce electricity for another five years after the expiry of the SDE+ subsidy period of 15 years.

Developments in offshore wind are evolving rapidly, with a clear tendency towards an increasingly longer lifespan for offshore wind farms. For example, the certified lifespan of the latest generation of wind turbines is 25 years<sup>61</sup> in many cases, while there are offshore wind farms still in use after 20 years.<sup>62</sup>

---

<sup>58</sup> The ACM also assesses the efficiency of TenneT's investments and determines the translation of those investments into the costs that TenneT is allowed to pass on in the regulated tariff income. In addition to a reasonable return on investment, those costs include the depreciations and costs for maintenance and management.

<sup>59</sup> Method Decision for the Grid Operator of the Offshore Grid 2022-2026; Decision of the Netherlands Authority for Consumers and Markets as referred to in Section 42b(1) of the Electricity Act 1998. 16 September 2021.

<sup>60</sup> Parliamentary Paper 33 561, No. 19.

<sup>61</sup> The MHI Vestas V164-10.0MW is an example of this. See <https://www.mhivestasoffshore.com/innovations/>

<sup>62</sup> The first offshore wind farm in the world, Vindeby in Denmark, became operational in 1991 and was decommissioned in September 2017.

Section 15 of the Offshore Wind Energy Act stipulates that the period for which the permit applies is appropriate to the expected lifespan of a wind farm and the specific area to which the permit relates. The Wind Farm Site Decisions determine the actual permit period, which includes the periods for development, operation and removal of the wind farm. The permits are based on the following assumptions:

- The construction of the wind farm will be completed in five years at most, starting from the date on which the permit becomes irrevocable.
- The wind farm may become operational from Year 3 and may continue to be operational in the penultimate year of the permit period.
- The removal period may start from the sixth year before the end of the permit period and may continue into the last year of the permit period.

In practice, this generally means the operating period of an offshore wind farm is about five years shorter, but at least three years shorter, than the maximum permit period. Permits for the sites in the Borssele, Hollandse Kust (zuid) and Hollandse Kust (noord) Wind Farm Zones have been issued for a maximum period of 30 years. This means that the minimum lifespan of the offshore grid for these wind farm zones is initially 27 years.

### **5.2.2 Longer permit period for offshore wind farms**

The entry into force of the amended Offshore Wind Energy Act on 29 October 2021 means the aforementioned Section 15 was modified, with the maximum permit period for offshore wind farms changed from 30 years to 40 years. In addition, wind farm permit holders already awarded a permit with a term less than 40 years can apply for an extension of the permit.

A longer permit period for offshore wind farms means the lifespan of the offshore grid must also be longer. A distinction must be made between wind farms that have yet to be granted a permit under the amended Offshore Wind Energy Act and wind farms already issued a permit under this Act:

- Parts of the offshore grid for wind farms yet to be granted a permit under the amended Offshore Wind Energy Act can be made suitable for a longer service life at an early stage (design phase). Once the Bill was submitted to the House of Representatives (November 2018), this Development Framework stated that a different lifespan can be set for all or parts of the offshore grid with a view to possibly extending the permit period of the wind farms to a maximum of 40 years (Development Framework, version of November 2019). This was further tightened in the May 2020 Development Framework by requiring TenneT to take into account a possible lifespan extension of up to 10 years as much and efficiently as possible.
- For wind farms already granted a permit, the relevant parts of the offshore grid are already in use or at an advanced stage of development. It is more difficult to achieve a longer lifespan for these parts of the offshore grid, as adjustments in the design phase are no longer possible. A longer lifespan can only be achieved by adjusting the maintenance and replacement strategy. During the consultation for the aforementioned amendment to the Offshore Wind Energy Act, TenneT indicated it would be able to cost-effectively extend the service life of the offshore grid by a few years for wind farms already issued with permits. The sooner parties (both the wind farm permit holder and TenneT) know what the final lifespan will be, the more cost-effectively the maintenance regime can be set up. An extension to the permit can be requested from seven years after the original permit was issued.

Criteria established in accordance with Section 3(3) of the Offshore Wind Energy Act will be taken into account when granting an extension, including the importance of an efficient connection of a wind farm to a connection point. The possibilities and impossibilities of keeping the offshore grid available for longer and associated costs will also be taken into account before an extension is granted. Based on the signals at the time of the consultation about the technical lifespan of the already licensed wind farms and associated offshore grids, an extension covering the full ten years in advance does not always appear to be the best option. It may be that a shorter extension is more in line with the technical lifespan of some wind farms and would make it easier for TenneT to extend the lifespan of the offshore grid in a cost-efficient manner. Ultimately, suitable extension periods will therefore have to be decided on a case-by-case basis for each requested extension, given all interests.

### ***5.2.3 Requirements for the lifespan of the offshore grid***

In view of the above, this Development Framework stipulates that the minimum lifespan of the offshore grid is 37 years for wind farms issued a permit under the amended Offshore Wind Energy Act, starting with the future wind farms in Hollandse Kust (west).

For the wind farms in the Borssele, Hollandse Kust (zuid) and Hollandse Kust (noord) Wind Farm Zones, this Development Framework stipulates that TenneT should take into account a potential service life extension as efficiently as possible. The precise scope of this will be determined once an application for an extension of the permit for the relevant part of the offshore grid has been submitted.

Specifically for construction of hybrid connections (the combination of a connection to connect a wind farm and an interconnector, as referred to in Section 3.9), it may be desirable to agree a longer service life for the relevant part of the offshore grid. Once a decision has been made about a hybrid connection, any implications for the required lifespan of the offshore grid will be laid down in this Development Framework.

Development Framework for Offshore Wind Energy  
Ministry of Climate and Green Growth  
Directorate-General for Climate and Energy  
PO Box 20401  
2500 EK The Hague

Final  
Adopted by the Council of Ministers in May 2025